

## SLED9122SR LUMINARIA LINEAR DE SOBREPOR 2x2 19Wm 3000K 80 1M



Fluxo luminoso – 1164 lm/m

Potência – 19,4 W/m

Intensidade pico – 466cd

CCT – 2933K




IRC – 81,5

Coordenada CIE 1931 – x- 0,440 y- 0,401

Data do ensaio

23/08/2024 13:43:00

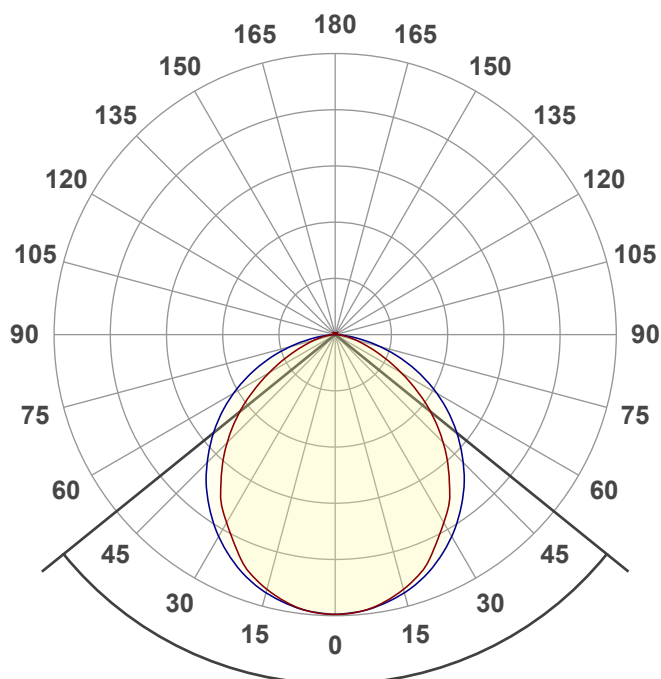

Facho de abertura

**102,1°**


**Rf 83,3**



Fidelity index Rf

**Rg 93,9**


Gamut index Rg

Hue Bin	R <sub>f</sub>	Shifts (%)	
		Chroma	Hue
1	78	-12%	1%
2	80	-8%	7%
3	78	-3%	11%
4	89	-2%	4%
5	93	0%	3%
6	93	0%	-3%
7	86	-7%	-4%
8	90	-6%	1%
9	85	-6%	7%
10	79	-3%	13%
11	80	2%	15%
12	85	7%	2%
13	86	4%	-9%
14	78	4%	-17%
15	83	-5%	-9%
16	73	-10%	-18%

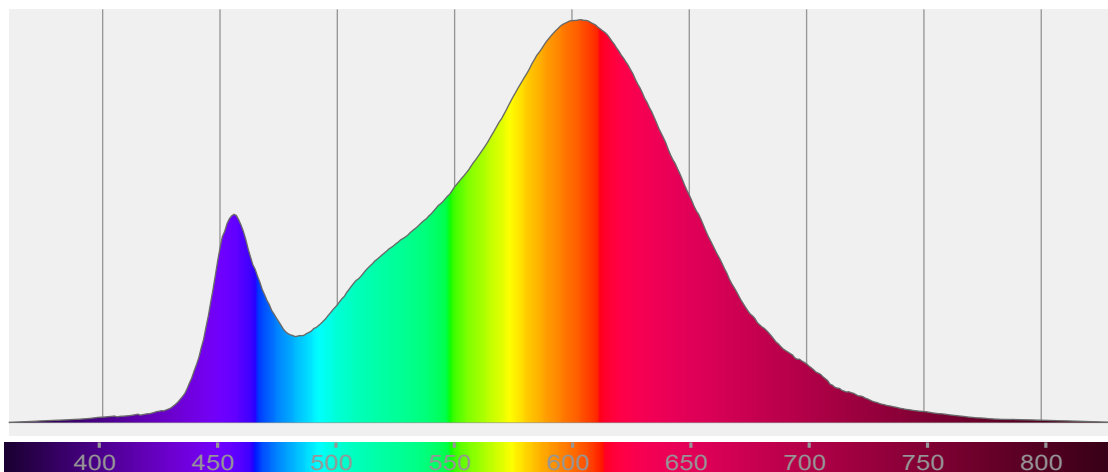


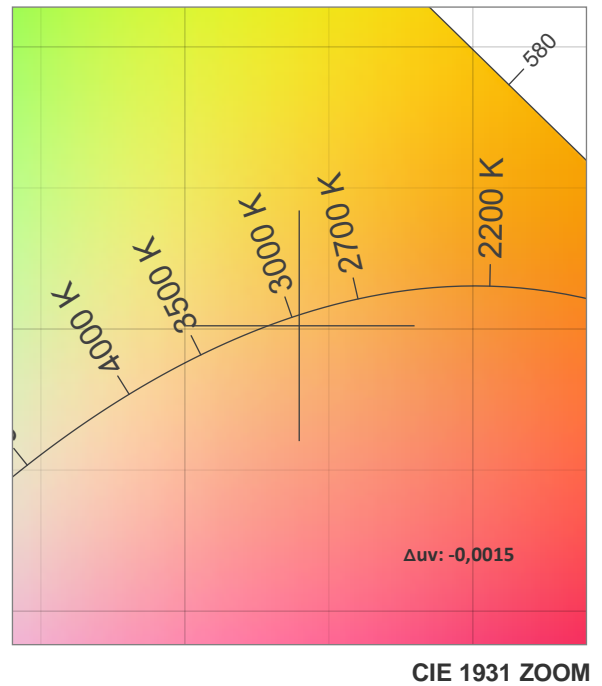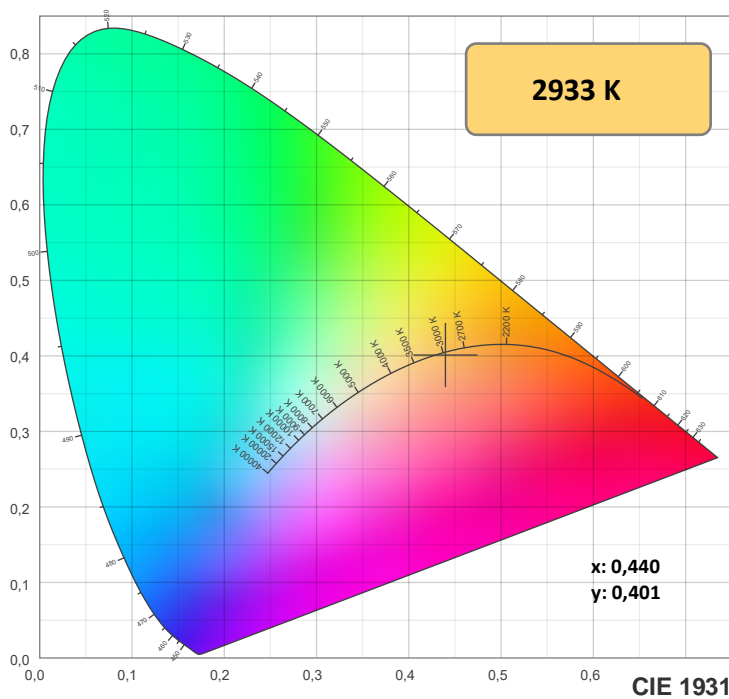

TM-30: 83,3

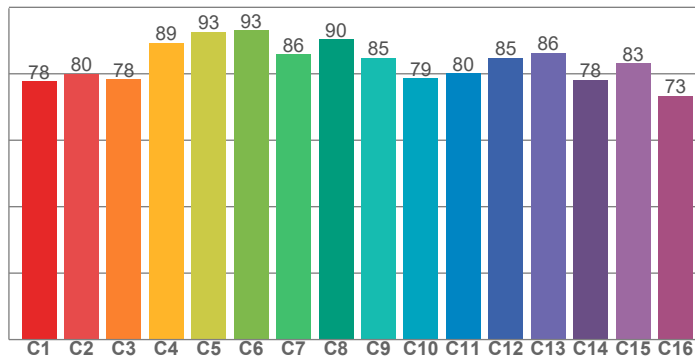

CRI: 81,5 (R1-R8)

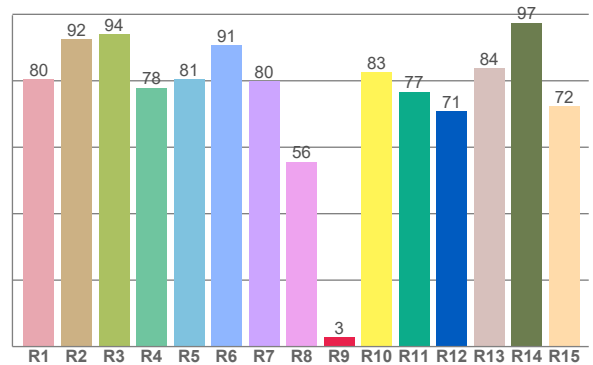

CRIRA R1-R8 / CRIR R1-R15

R1	R2	R3	R4	R5	R6	R7	R8	R9	R10	R11	R12	R13	R14	R15
80,5	92,5	93,9	77,9	80,5	90,8	79,9	55,6	2,9	82,5	76,7	70,8	83,7	97,5	72,3

TM30 valores C. 16 valores extraídos dos 99.

C1	C2	C3	C4	C5	C6	C7	C8	C9	C10	C11	C12	C13	C14	C15	C16
77,7	79,9	78,3	89,4	92,7	93,1	85,9	90,3	84,8	78,6	80,1	84,8	86,4	78,3	83,2	73,3

## Parametros de cor

Temperatura de cor	Índice de reprodução de cor	Reprodução de cor vermelho R9	Color fidelity	Color gamut	Color quality scale	Coordenada de cor cie 1931	Coordenada de cor cie 1931	Coordenada de cor	Coordenada de cor	Color deviation from black body
CCT	IRC	CRI R9	TM30 Rf	TM30 Rg	CQS	x	y	u	v	$\Delta uv$
2933 K	81,5	2,9	83,3	93,9	80,6	0,440	0,401	0,254	0,347	-0,0015







**Rf 83,3**

Fidelity index Rf

**Rg 93,9**

Gamut index Rg

Hue Bin	R <sub>f</sub>	Shifts (%)	
		Chroma	Hue
1	78	-12%	1%
2	80	-8%	7%
3	78	-3%	11%
4	89	-2%	4%
5	93	0%	3%
6	93	0%	-3%
7	86	-7%	-4%
8	90	-6%	1%
9	85	-6%	7%
10	79	-3%	13%
11	80	2%	15%
12	85	7%	2%
13	86	4%	-9%
14	78	4%	-17%
15	83	-5%	-9%
16	73	-10%	-18%

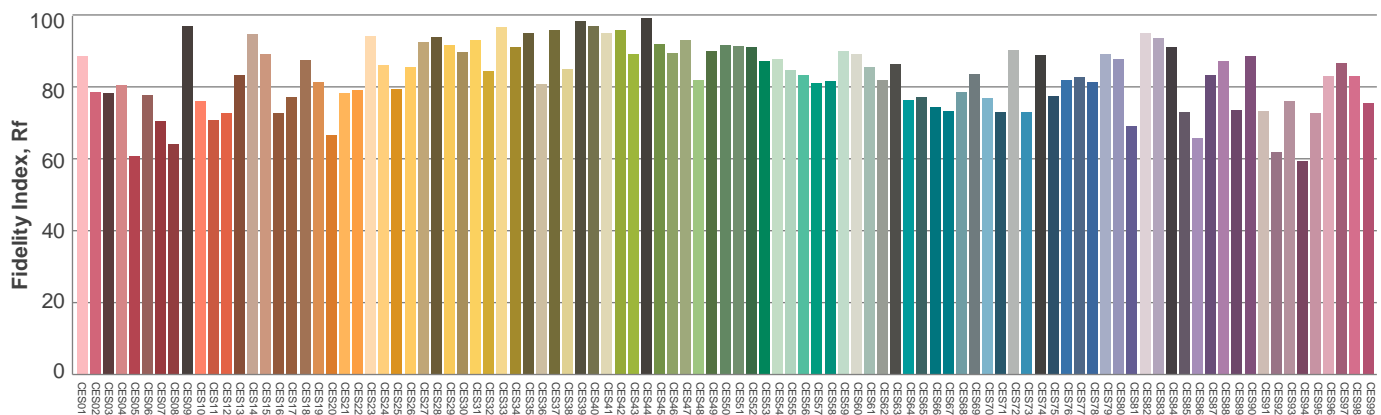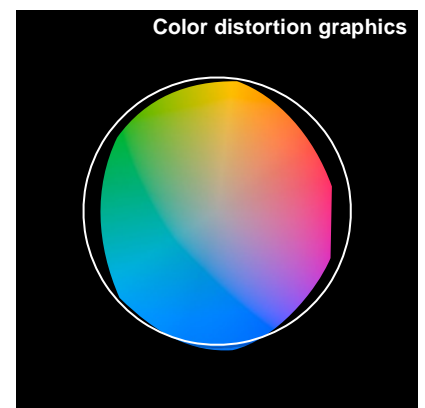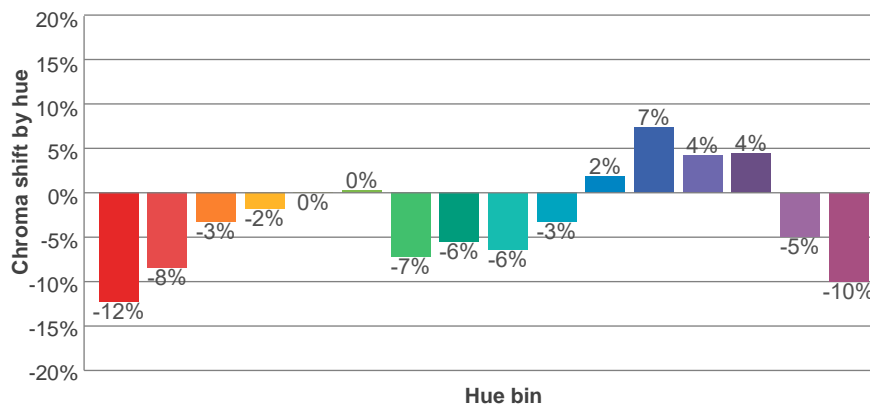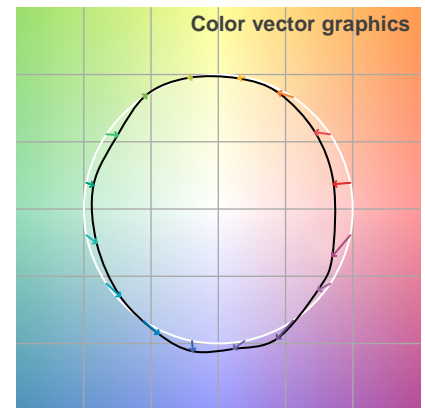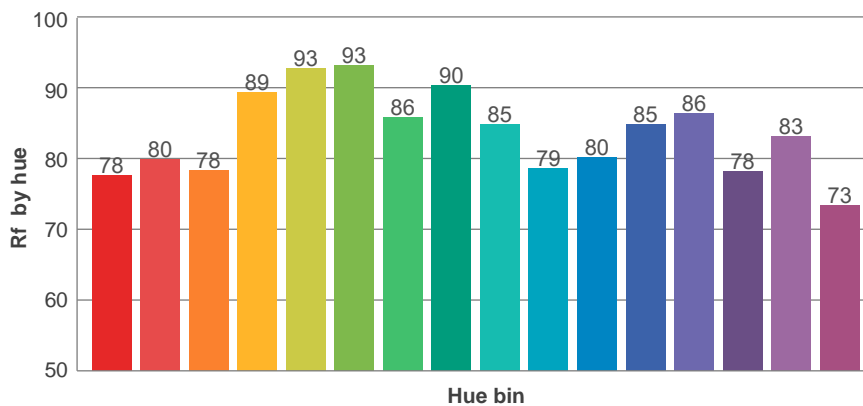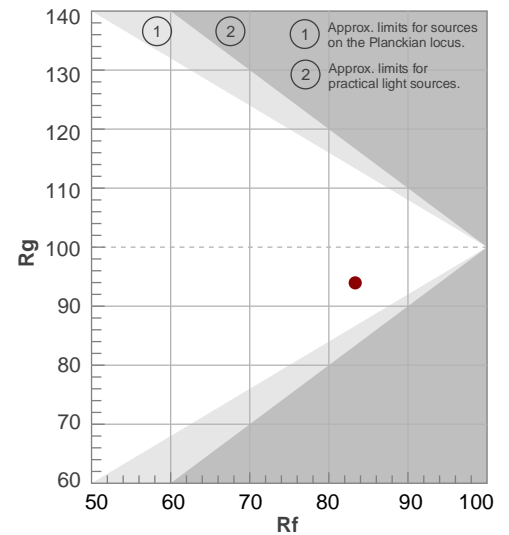

Avaliação todas as amostras de cores

Glare Evaluation According to UGR


p Ceiling		70	70	50	50	30	70	70	50	50	30
p Walls		50	30	50	30	30	50	30	50	30	30
p Floor		20	20	20	20	20	20	20	20	20	20
Room size X    Y		Viewing direction at right angles to lamp axis					Viewing direction parallel to lamp axis				
2H	2H	21,5	22,7	21,8	23,0	23,2	23,1	24,2	23,3	24,6	24,8
	3H	22,2	23,4	22,7	23,7	23,9	24,5	25,7	24,9	26,0	26,2
	4H	22,5	23,6	22,9	23,9	24,2	25,0	26,2	25,5	26,5	26,7
	6H	22,7	23,7	23,0	24,0	24,4	25,5	26,4	25,8	26,7	27,1
	8H	22,8	23,7	23,1	24,0	24,5	25,5	26,5	25,9	26,8	27,3
	12H	22,8	23,7	23,1	24,0	24,5	25,6	26,5	26,0	26,9	27,3
4H	2H	22,1	23,3	22,6	23,6	23,8	23,4	24,5	23,8	24,8	25,1
	3H	23,1	24,0	23,5	24,4	24,9	25,1	26,0	25,5	26,4	26,9
	4H	23,4	24,2	23,8	24,7	25,2	25,7	26,5	26,1	27,0	27,5
	6H	23,6	24,4	24,1	24,8	25,2	26,1	27,0	26,6	27,3	27,7
	8H	23,7	24,4	24,2	24,8	25,2	26,3	27,0	26,8	27,4	27,8
	12H	23,7	24,3	24,2	24,7	25,2	26,3	27,0	26,8	27,4	27,9
8H	4H	23,6	24,4	24,1	24,8	25,2	25,7	26,5	26,3	26,9	27,3
	6H	23,9	24,5	24,5	25,0	25,6	26,3	26,9	26,8	27,3	27,9
	8H	24,1	24,6	24,6	25,1	25,8	26,5	27,0	27,0	27,5	28,2
	12H	24,1	24,6	24,7	25,1	25,7	26,6	27,0	27,2	27,6	28,2
12H	4H	23,6	24,2	24,1	24,7	25,2	25,7	26,3	26,2	26,8	27,3
	6H	24,0	24,5	24,5	25,0	25,7	26,3	26,8	26,8	27,3	28,0
	8H	24,1	24,5	24,7	25,1	25,7	26,5	26,9	27,1	27,4	28,1
Variation of the observer position for the luminaire distance S											
S = 1.0H		0,2 / -0,2					0,1 / -0,1				
S = 1.5H		0,4 / -0,7					0,2 / -0,3				
S = 2.0H		1,0 / -1,4					0,6 / -0,7				
Standard table		n/a					n/a				
Correction summand		n/a					n/a				
Corrected glare indices referring to 1164 lm total luminous flux											


**Coeficiente de utilização**

Ceiling reflectance	80				70				50			30			10			0
Wall reflectance	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
Floor reflectance	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	0
RCR	(RCR: Room Cavity Ratio) Room Values are expressed as percentage of Lumens delivered to the task surface																	
0	119	119	119	119	116	116	116	116	110	110	110	106	106	106	101	101	101	99
1	109	105	101	97	107	103	99	96	98	95	93	94	92	89	90	88	87	85
2	100	92	86	81	97	90	84	79	87	82	77	83	79	76	80	77	74	72
3	92	82	74	68	89	80	73	67	77	71	66	74	69	64	71	67	63	61
4	84	73	64	58	82	71	63	57	69	62	56	66	60	56	64	59	55	53
5	78	65	57	50	75	64	56	50	62	55	49	60	53	49	58	52	48	46
6	72	59	50	44	70	58	50	44	56	49	43	54	48	43	53	47	42	40
7	67	53	45	39	65	53	45	39	51	44	38	49	43	38	48	42	38	36
8	62	49	41	35	60	48	40	35	47	40	35	45	39	34	44	38	34	32
9	58	45	37	32	57	44	37	31	43	36	31	42	36	31	41	35	31	29
10	54	42	34	29	53	41	34	29	40	33	28	39	33	28	38	32	28	26

**Quantidade de luminárias**

**Luminaire budgetary diagram**

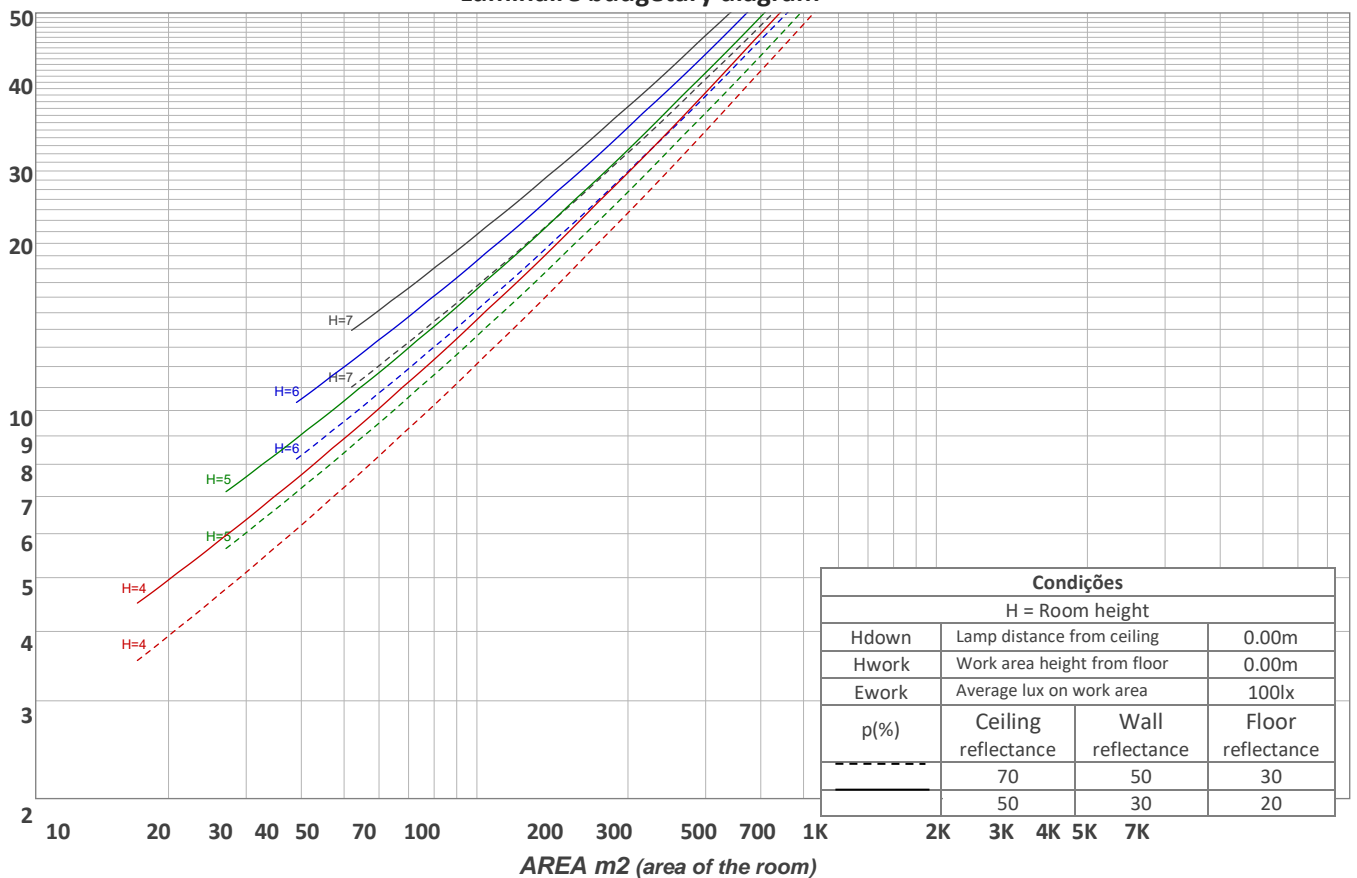

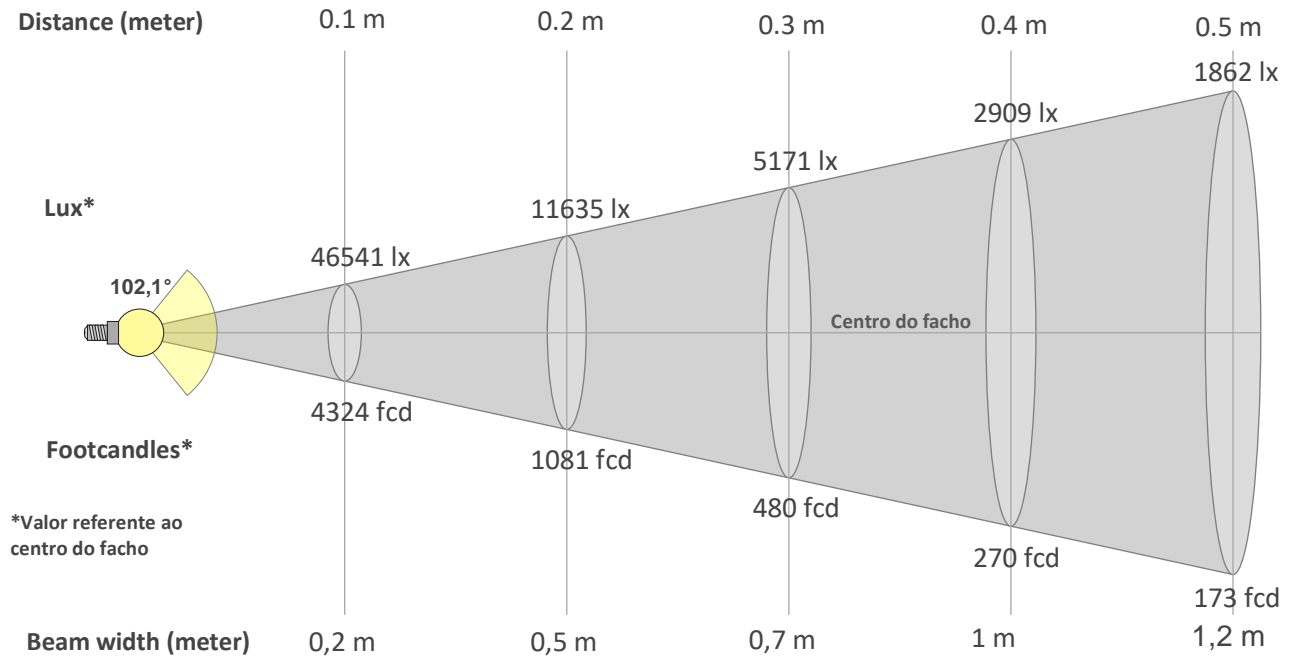

### Beam intensities from 1-20m

1m	2m	3m	4m	5m	6m	7m	8m	9m	10m	11m	12m	13m	14m	15m	16m	17m	18m	19m	20m
3,3ft	6,6ft	9,8ft	13,1ft	16,4ft	19,7ft	23ft	26,2ft	29,5ft	32,8ft	36,1ft	39,4ft	42,7ft	45,9ft	49,2ft	52,5ft	55,8ft	59,1ft	62,3ft	65,6ft
465lx	116lx	52lx	29lx	19lx	13lx	9lx	7lx	6lx	5lx	4lx	3lx	3lx	2lx	2lx	2lx	2lx	1lx	1lx	1lx
43,2fcd	10,8fcd	4,8fcd	2,7fcd	1,7fcd	1,2fcd	0,9fcd	0,7fcd	0,5fcd	0,4fcd	0,4fcd	0,3fcd	0,3fcd	0,2fcd	0,2fcd	0,2fcd	0,1fcd	0,1fcd	0,1fcd	0,1fcd

### Intensities in 0° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°
465	462	453	438	419	392	363	330	293	254	213	170	128	90	60	37	21	9	3	2
100%	99%	97%	94%	90%	84%	78%	71%	63%	55%	46%	37%	27%	19%	13%	8%	4%	2%	1%	0%

### Intensities in 90° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°
465	462	455	445	430	410	388	362	333	301	268	232	195	157	117	78	42	16	4	2
100%	99%	98%	96%	92%	88%	83%	78%	72%	65%	57%	50%	42%	34%	25%	17%	9%	3%	1%	0%

### Intensities in 180° c-plane


0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°
465	462	453	438	419	392	363	330	293	254	213	170	128	90	60	37	21	9	3	2
100%	99%	97%	94%	90%	84%	78%	71%	63%	55%	46%	37%	27%	19%	13%	8%	4%	2%	1%	0%

### Intensities in 270° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°
465	462	455	445	430	410	388	362	333	301	268	232	195	157	117	78	42	16	4	2
100%	99%	98%	96%	92%	88%	83%	78%	72%	65%	57%	50%	42%	34%	25%	17%	9%	3%	1%	0%

Beam angle 50%	Field angle 10%	Cutoff angle 2,5%	Intensity ratio in 120° cone	Intensity ratio in 90° cone
102,1°	151,2°	168,7°	82,6%	58,2%

**iso-candela diagram**

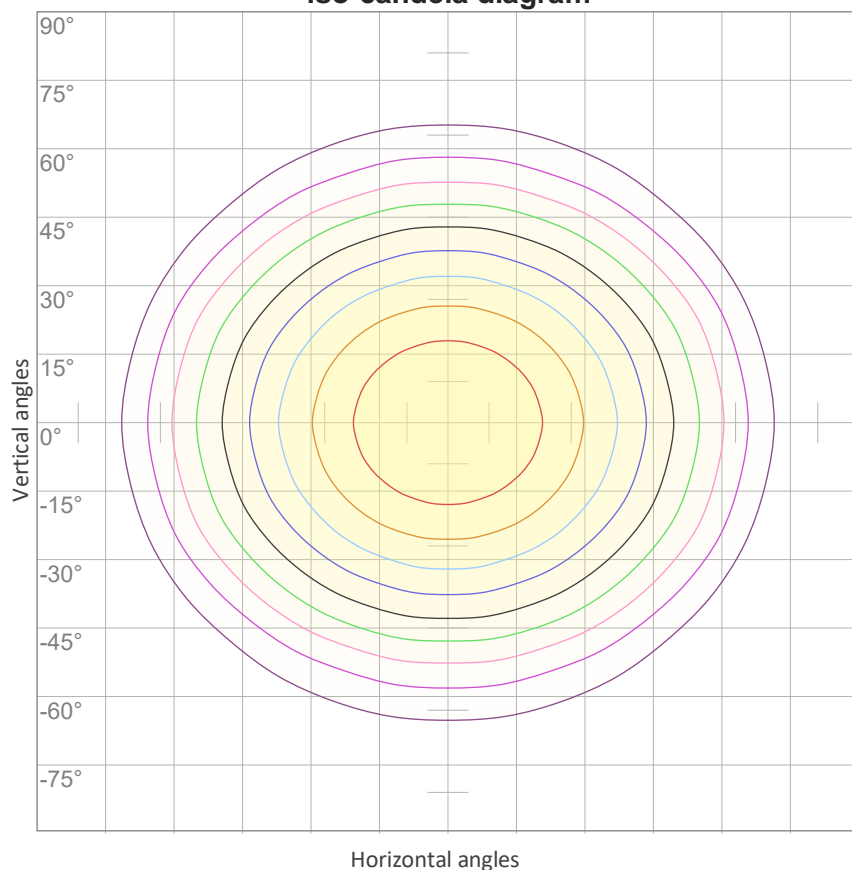


10%	47 cd
20%	93 cd
30%	140 cd
40%	186 cd
50%	233 cd
60%	279 cd
70%	326 cd
80%	372 cd
90%	419 cd

Conditions:

Number of c-planes: 16

Candela at center: 465 cd

**iso-lux diagram**

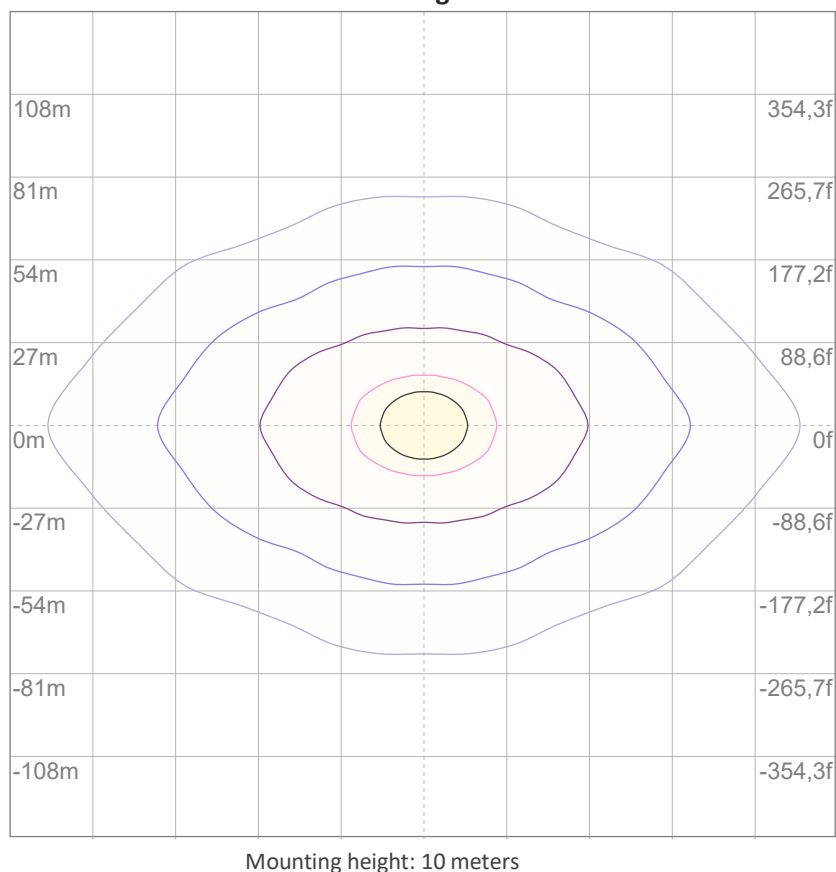

3%	0,140 lx
5%	0,233 lx
10%	0,465 lx
30%	1,40 lx
50%	2,33 lx

Conditions:

Number of c-planes: 16

Lux at center: 4,65 lx

*Lux distribution on a surface when lamp is mounted at 10 meters from the surface.*

**Potência**



**Vttagem: 12,0 V**

**Corrente: 1,62 A**

**Frequência: 0 Hz**

**FP: 1,0**

**THD**



**THD corrente: n/a**

**THD tensão: n/a**