

## SLED9122SR LUMINARIA LINEAR DE SOBREPOR 2x2 20Wm 3500K 95 1M



Fluxo luminoso – 961 lm/m

Potência – 19,4 W/m

Intensidade pico – 383cd

CCT – 3464K




IRC – 96,7

Coordenada CIE 1931 – x- 0,406 y- 0,389

Data do ensaio

30/08/2024 15:27:48

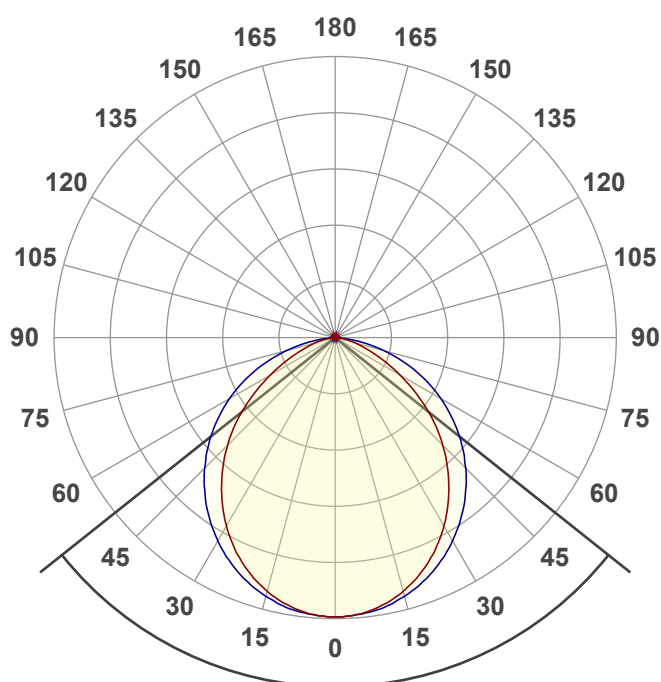

Facho de abertura

**103°**


**Rf 93,2**



Fidelity index Rf

**Rg 100,5**


Gamut index Rg

		Shifts (%)	
Hue Bin	R <sub>f</sub>	Chroma	Hue
1	95	-2%	0%
2	96	-1%	1%
3	94	0%	2%
4	95	-1%	1%
5	94	-3%	1%
6	97	1%	0%
7	95	-2%	1%
8	97	-1%	1%
9	94	-1%	4%
10	89	-1%	7%
11	88	3%	8%
12	91	4%	3%
13	95	2%	-2%
14	91	5%	-4%
15	92	1%	-4%
16	90	1%	-6%

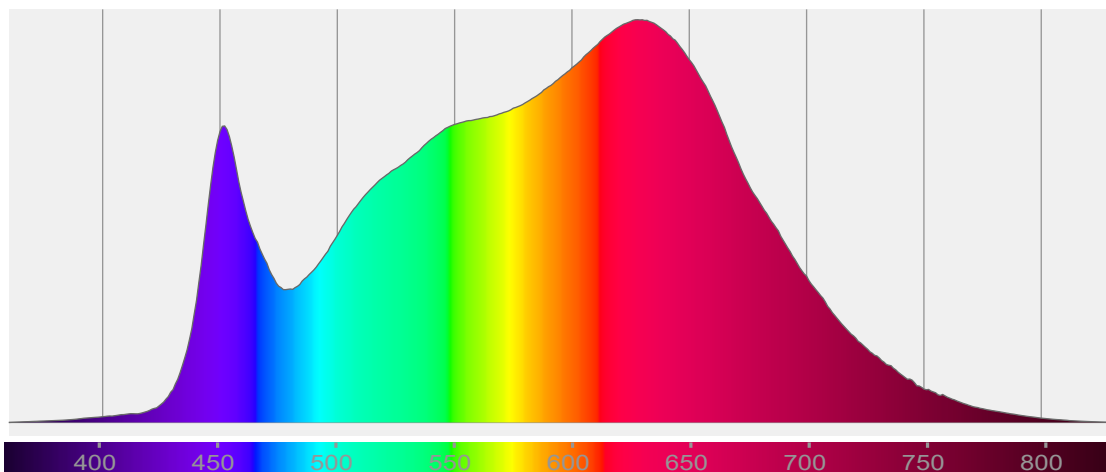


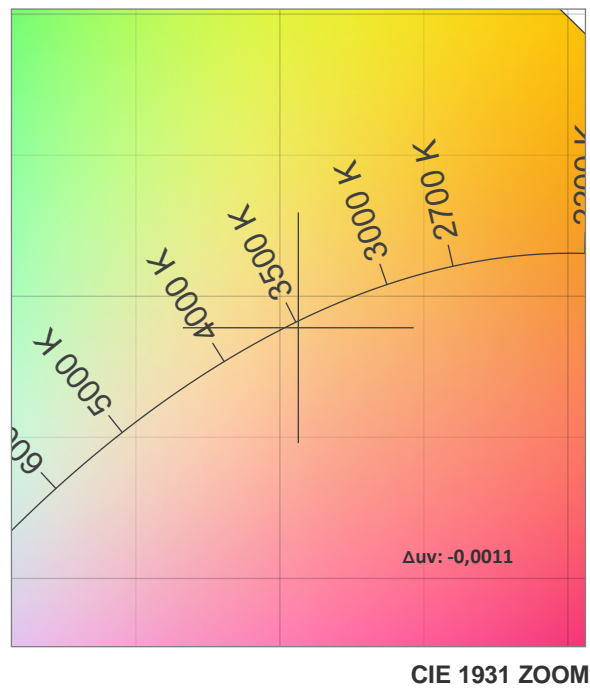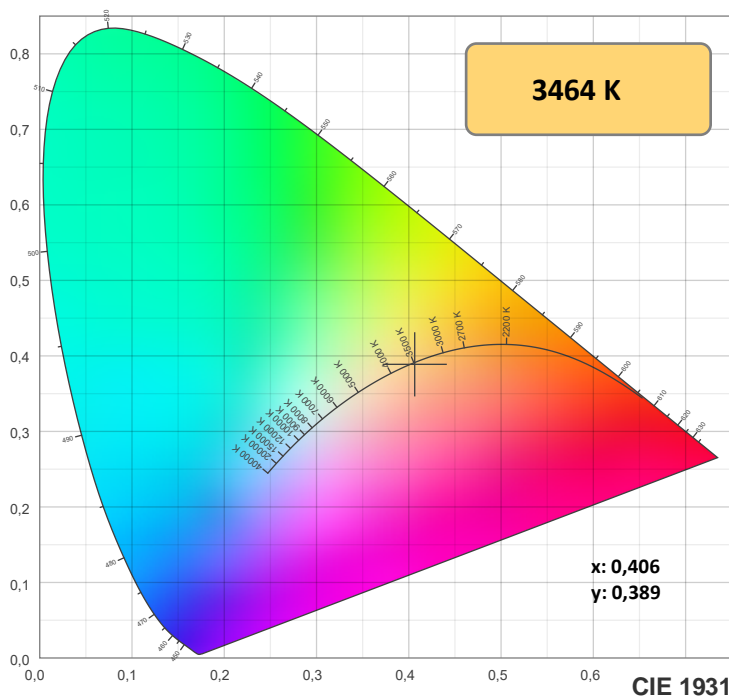

TM-30: 93,2

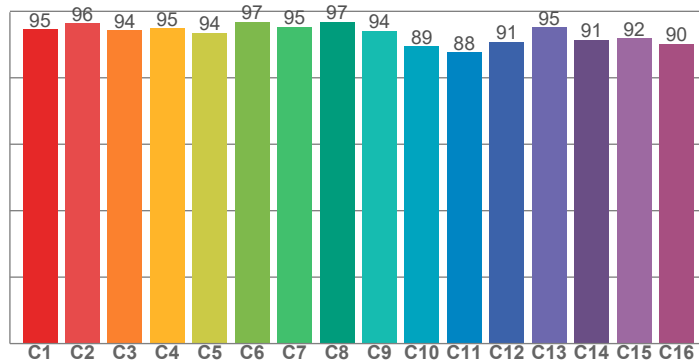

CRI: 96,7 (R1-R8)

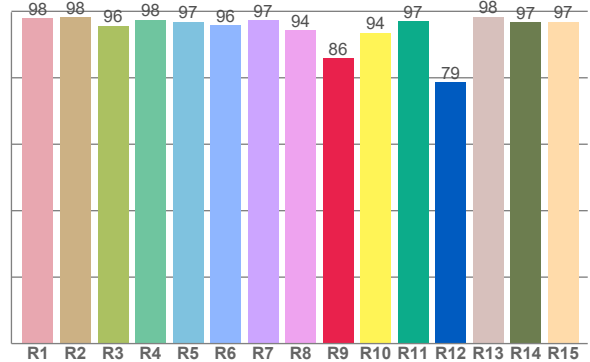

CRIRA R1-R8 / CRIR R1-R15

R1	R2	R3	R4	R5	R6	R7	R8	R9	R10	R11	R12	R13	R14	R15
98,0	98,1	95,6	97,5	96,9	95,7	97,3	94,4	85,8	93,6	96,9	78,7	98,4	96,8	96,8

TM30 valores C. 16 valores extraídos dos 99.

C1	C2	C3	C4	C5	C6	C7	C8	C9	C10	C11	C12	C13	C14	C15	C16
94,6	96,4	94,2	94,9	93,5	96,9	95,3	96,8	94,1	89,4	87,6	90,9	95,1	91,4	91,8	90,3

## Parametros de cor

Temperatura de cor	Índice de reprodução de cor	Reprodução de cor vermelho R9	Color fidelity	Color gamut	Color quality scale	Coordenada de cor cie 1931	Coordenada de cor cie 1931	Coordenada de cor	Coordenada de cor	Color deviation from black body
CCT	IRC	CRI R9	TM30 Rf	TM30 Rg	CQS	x	y	u	v	Δuv
3464 K	96,7	85,8	93,2	100,5	94,7	0,406	0,389	0,237	0,340	-0,0011







**Rf 93,2**

Fidelity index Rf

**Rg 100,5**

Gamut index Rg

Hue Bin	R <sub>i</sub>	Shifts (%)	
		Chroma	Hue
1	95	-2%	0%
2	96	-1%	1%
3	94	0%	2%
4	95	-1%	1%
5	94	-3%	1%
6	97	1%	0%
7	95	-2%	1%
8	97	-1%	1%
9	94	-1%	4%
10	89	-1%	7%
11	88	3%	8%
12	91	4%	3%
13	95	2%	-2%
14	91	5%	-4%
15	92	1%	-4%
16	90	1%	-6%

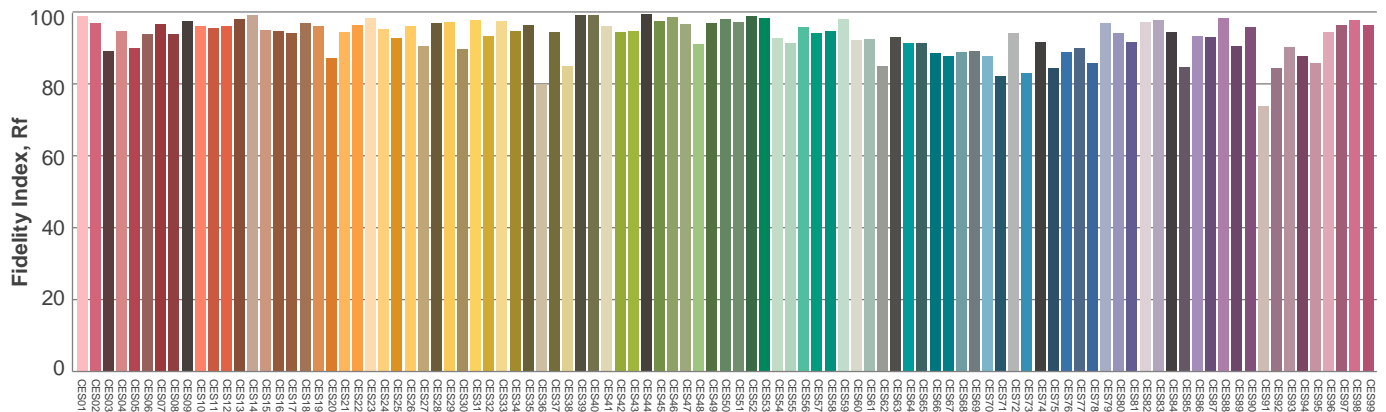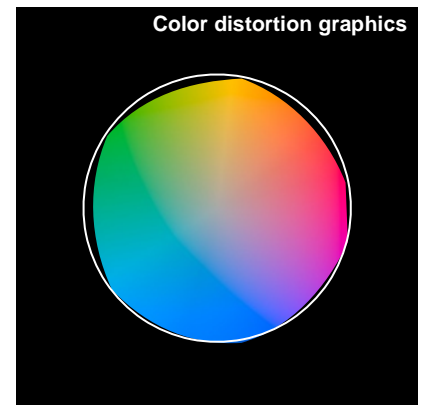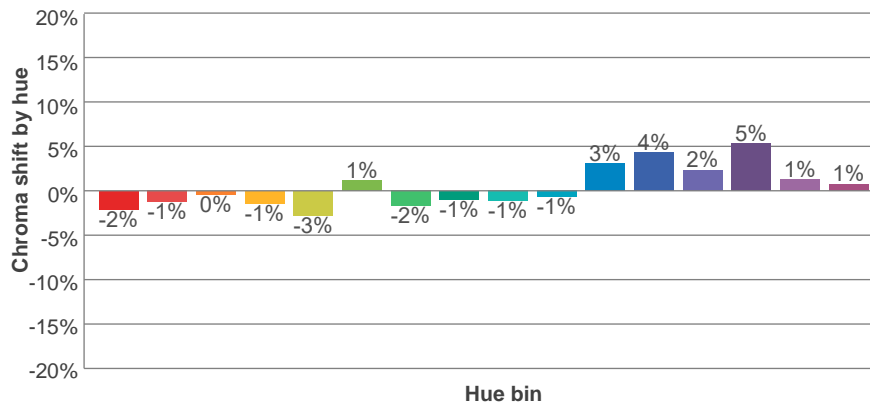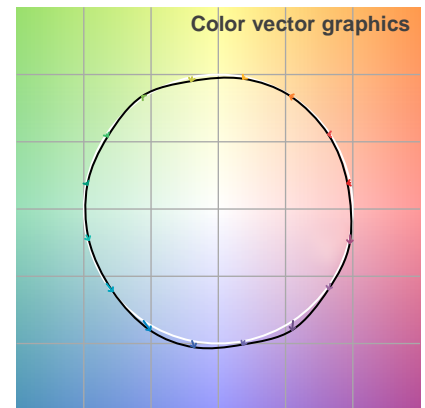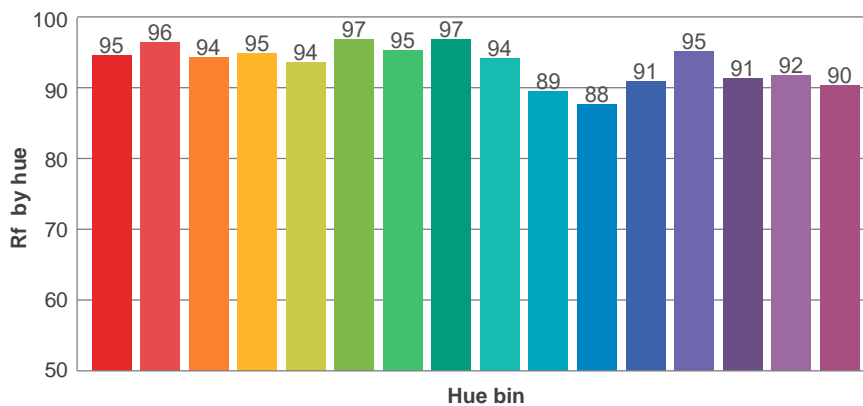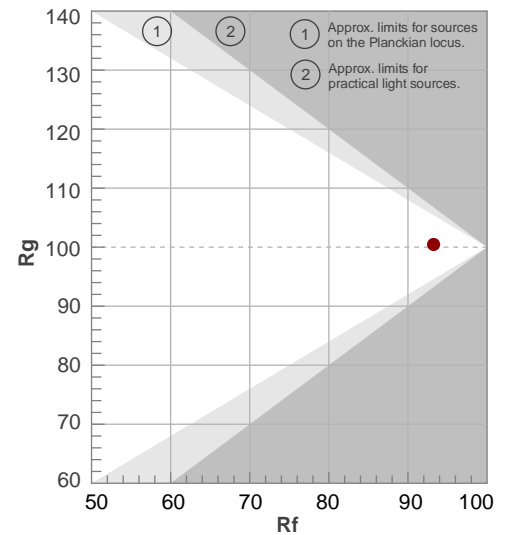

Avaliação todas as amostras de cores

Glare Evaluation According to UGR


p Ceiling		70	70	50	50	30	70	70	50	50	30
p Walls		50	30	50	30	30	50	30	50	30	30
p Floor		20	20	20	20	20	20	20	20	20	20
Room size X    Y		Viewing direction at right angles to lamp axis					Viewing direction parallel to lamp axis				
2H	2H	20,8	22,0	21,1	22,3	22,5	22,6	23,8	22,9	24,1	24,3
	3H	21,5	22,7	21,9	23,0	23,2	24,1	25,3	24,5	25,6	25,8
	4H	21,7	22,9	22,1	23,1	23,4	24,7	25,8	25,1	26,1	26,4
	6H	21,9	22,9	22,2	23,2	23,6	25,1	26,1	25,4	26,4	26,8
	8H	21,9	22,9	22,3	23,2	23,6	25,2	26,2	25,5	26,5	26,9
	12H	21,9	22,9	22,3	23,2	23,7	25,2	26,2	25,6	26,5	27,0
4H	2H	21,5	22,6	21,9	22,9	23,2	22,9	24,1	23,3	24,4	24,6
	3H	22,4	23,3	22,8	23,7	24,1	24,7	25,6	25,1	26,0	26,4
	4H	22,6	23,5	23,1	23,9	24,4	25,3	26,2	25,8	26,6	27,1
	6H	22,8	23,7	23,3	24,0	24,4	25,8	26,6	26,3	27,0	27,3
	8H	22,9	23,6	23,4	24,0	24,4	25,9	26,7	26,4	27,0	27,4
	12H	22,9	23,5	23,4	23,9	24,4	26,0	26,6	26,5	27,0	27,5
8H	4H	22,9	23,6	23,4	24,0	24,4	25,4	26,1	25,9	26,5	26,9
	6H	23,2	23,8	23,7	24,2	24,8	25,9	26,5	26,4	27,0	27,5
	8H	23,3	23,8	23,8	24,3	25,0	26,1	26,6	26,7	27,2	27,8
	12H	23,3	23,8	23,9	24,3	24,9	26,3	26,7	26,9	27,2	27,8
12H	4H	22,9	23,5	23,4	23,9	24,4	25,3	25,9	25,8	26,4	26,9
	6H	23,3	23,8	23,8	24,3	24,9	26,0	26,4	26,5	27,0	27,6
	8H	23,4	23,8	24,0	24,3	24,9	26,1	26,6	26,7	27,1	27,7
Variation of the observer position for the luminaire distance S											
S = 1.0H		0,2 / -0,3					0,1 / -0,1				
S = 1.5H		0,5 / -0,8					0,2 / -0,3				
S = 2.0H		1,0 / -1,6					0,6 / -0,7				
Standard table		n/a					n/a				
Correction summand		n/a					n/a				
Corrected glare indices referring to 961 lm total luminous flux											


### Coeficiente de utilização

Ceiling reflectance	80				70				50			30			10			0
Wall reflectance	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
Floor reflectance	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	0
RCR	(RCR: Room Cavity Ratio) Room Values are expressed as percentage of Lumens delivered to the task surface																	
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	99
1	109	105	101	97	107	103	99	96	98	95	93	94	92	90	91	89	87	85
2	100	92	86	80	97	90	85	79	87	82	78	83	79	76	80	77	74	72
3	92	82	74	68	89	80	73	67	77	71	66	74	69	65	72	67	63	61
4	84	73	64	58	82	71	63	57	69	62	56	66	60	56	64	59	55	53
5	78	65	56	50	75	64	56	50	62	55	49	60	54	49	58	52	48	46
6	72	59	50	44	70	58	50	44	56	49	43	54	48	43	53	47	42	40
7	67	53	45	39	65	53	45	39	51	44	38	50	43	38	48	42	38	36
8	62	49	41	35	60	48	40	35	47	40	34	46	39	34	44	38	34	32
9	58	45	37	31	57	44	37	31	43	36	31	42	36	31	41	35	31	29
10	54	41	34	29	53	41	34	29	40	33	28	39	33	28	38	32	28	26

### Quantidade de luminárias

### Luminaire budgetary diagram

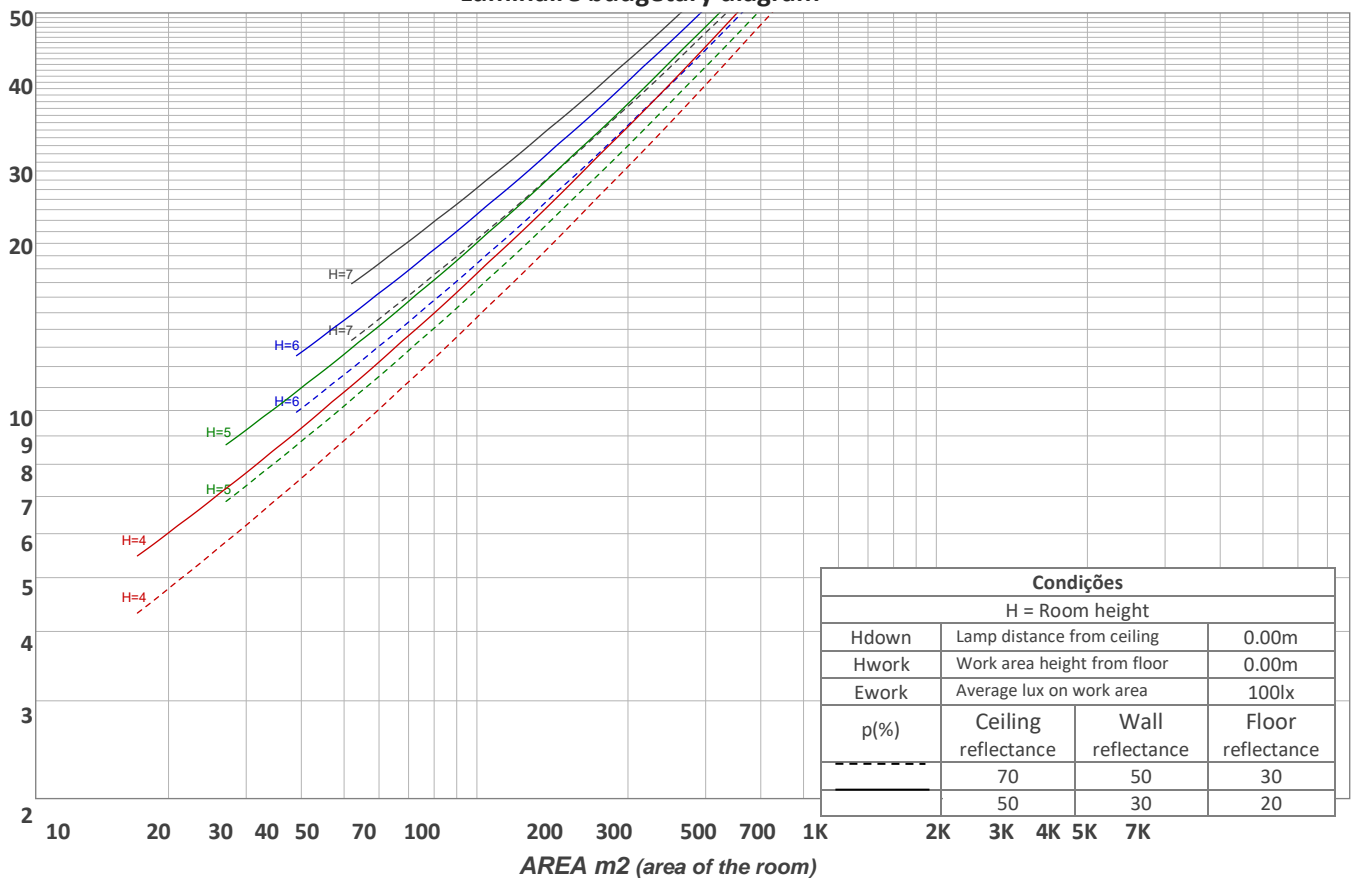

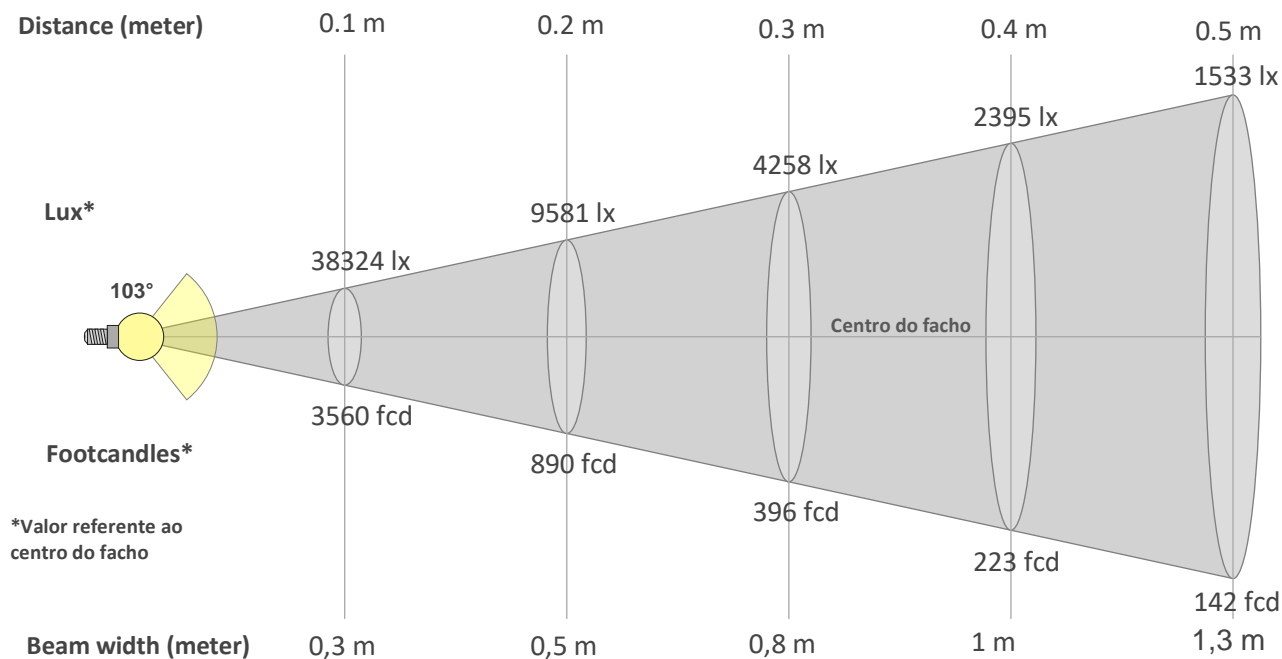

### Beam intensities from 1-20m

1m	2m	3m	4m	5m	6m	7m	8m	9m	10m	11m	12m	13m	14m	15m	16m	17m	18m	19m	20m
3,3ft	6,6ft	9,8ft	13,1ft	16,4ft	19,7ft	23ft	26,2ft	29,5ft	32,8ft	36,1ft	39,4ft	42,7ft	45,9ft	49,2ft	52,5ft	55,8ft	59,1ft	62,3ft	65,6ft
383lx	96lx	43lx	24lx	15lx	11lx	8lx	6lx	5lx	4lx	3lx	3lx	2lx	2lx	2lx	1lx	1lx	1lx	1lx	1lx
35,6fcd	8,9fcd	4fcd	2,2fcd	1,4fcd	1fcd	0,7fcd	0,6fcd	0,4fcd	0,4fcd	0,3fcd	0,2fcd	0,2fcd	0,2fcd	0,2fcd	0,1fcd	0,1fcd	0,1fcd	0,1fcd	0,1fcd

### Intensities in 0° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°
383	381	373	361	343	323	298	271	241	209	175	138	103	72	46	29	17	5	1	1
100%	99%	97%	94%	90%	84%	78%	71%	63%	54%	46%	36%	27%	19%	12%	8%	4%	1%	0%	0%

### Intensities in 90° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°
383	381	377	367	355	340	322	301	278	253	226	197	167	136	103	69	38	12	1	1
100%	99%	98%	96%	93%	89%	84%	79%	73%	66%	59%	52%	44%	35%	27%	18%	10%	3%	0%	0%

### Intensities in 180° c-plane


0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°
383	381	373	361	343	323	298	271	241	209	175	138	103	72	46	29	17	5	1	1
100%	99%	97%	94%	90%	84%	78%	71%	63%	54%	46%	36%	27%	19%	12%	8%	4%	1%	0%	0%

### Intensities in 270° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°
383	381	377	367	355	340	322	301	278	253	226	197	167	136	103	69	38	12	1	1
100%	99%	98%	96%	93%	89%	84%	79%	73%	66%	59%	52%	44%	35%	27%	18%	10%	3%	0%	0%

Beam angle 50%	Field angle 10%	Cutoff angle 2,5%	Intensity ratio in 120° cone	Intensity ratio in 90° cone
103°	151,1°	168,9°	82,9%	58,3%

**iso-candela diagram**

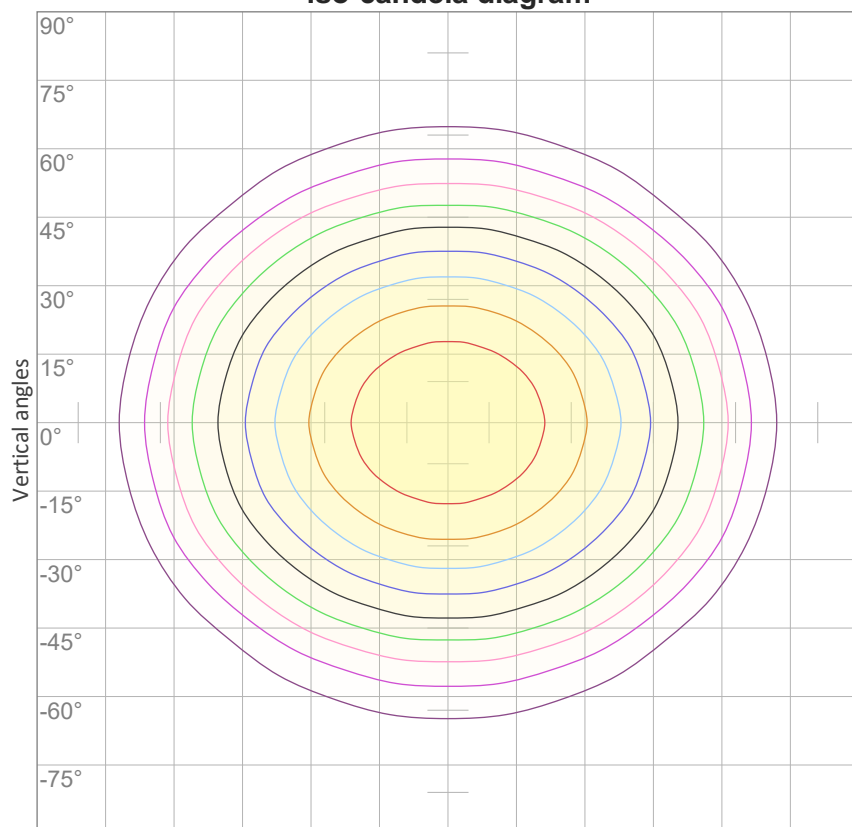

Horizontal angles


10%	38 cd
20%	77 cd
30%	115 cd
40%	153 cd
50%	192 cd
60%	230 cd
70%	268 cd
80%	307 cd
90%	345 cd

Conditions:

Number of c-planes: 16

Candela at center: 383 cd

**iso-lux diagram**

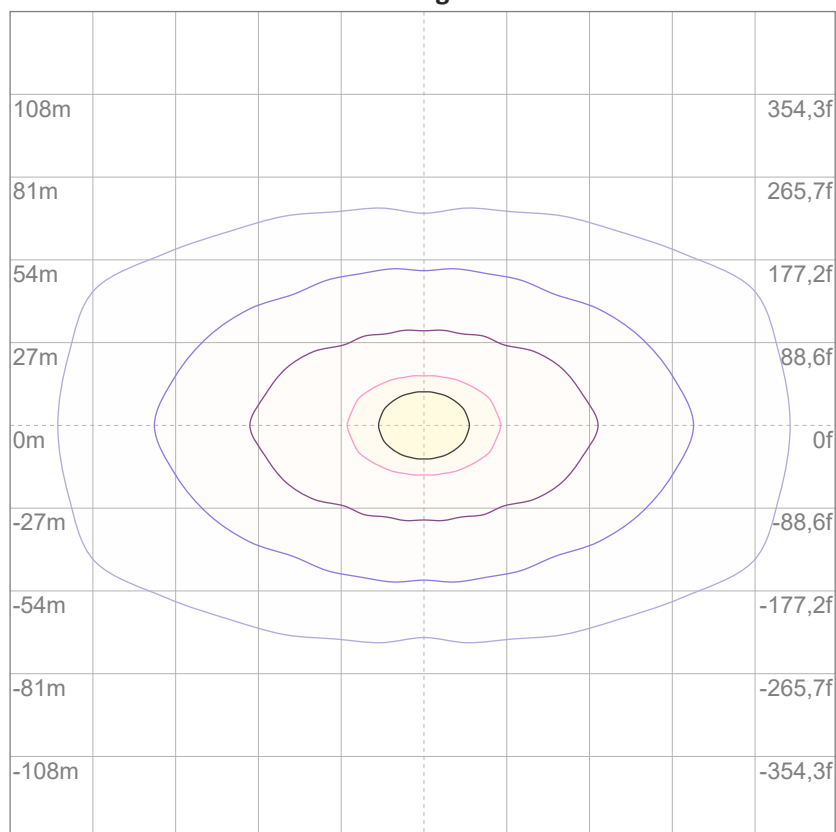

Mounting height: 10 meters

3%	0,115 lx
5%	0,192 lx
10%	0,383 lx
30%	1,15 lx
50%	1,92 lx

Conditions:

Number of c-planes: 16

Lux at center: 3,83 lx

*Lux distribution on a surface when lamp is mounted at 10 meters from the surface.*

**Potência**



**Vttagem: 12,0 V**

**Corrente: 1,62 A**

**Frequência: 0 Hz**

**FP: 1,0**

**THD**



**THD corrente: n/a**

**THD tensão: n/a**