


## W110 SLED9007 BRANCA 2X FITA 15WM 3000K 95 - 1m

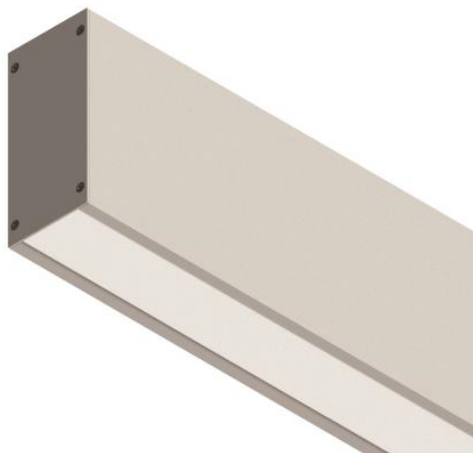

Luminária linear de sobrepor na parede com iluminação difusa. Corpo em alumínio extrudado com acabamento na cor branca. Difusor em acrílico extrudado leitoso. Indicado para residência, recepção, escritório etc.

Fluxo luminoso – 1566 lm/m

Potência – 29,8 W/m

Intensidade pico – 291cd

CCT – 2915K



IRC – 97,8

Coordenada CIE 1931 – x- 0,440 y- 0,399

A x L - 96x46

Peso - 1,43kg/m


IP - 20 - Uso Interno

IK - 00 – Não aplicável

Alimentação - 12vdc

Data do ensaio

06/04/2022 08:12:12

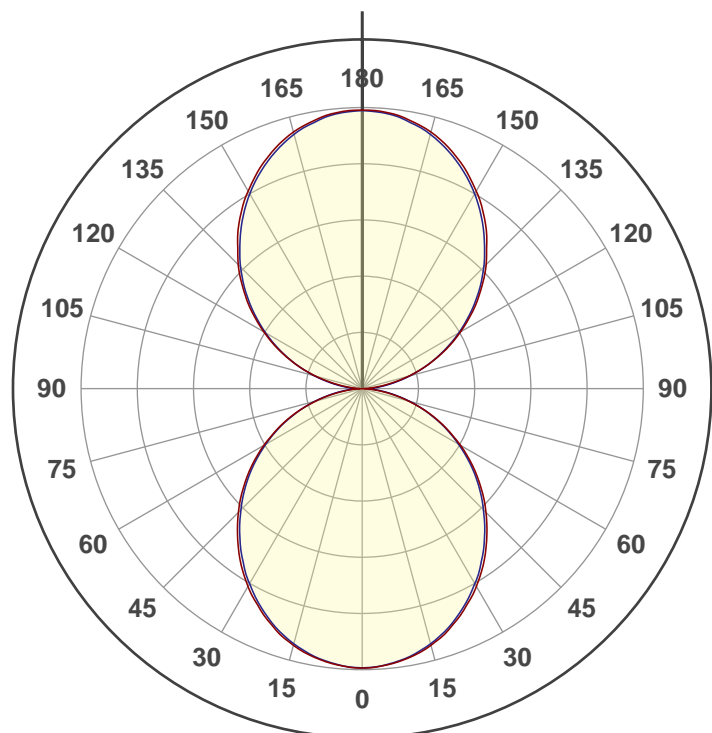

Facho de abertura

**360°**


**Rf 94,6**



Fidelity index Rf

**Rg 102,9**


Gamut index Rg

		Shifts (%)	
Hue Bin	R <sub>f</sub>	Chroma	Hue
1	97	-1%	0%
2	98	0%	1%
3	94	0%	3%
4	95	0%	1%
5	95	2%	3%
6	94	4%	1%
7	95	1%	-1%
8	97	1%	-2%
9	97	0%	1%
10	94	0%	3%
11	91	2%	6%
12	92	4%	2%
13	95	3%	-2%
14	93	5%	-3%
15	96	1%	-2%
16	90	2%	-8%

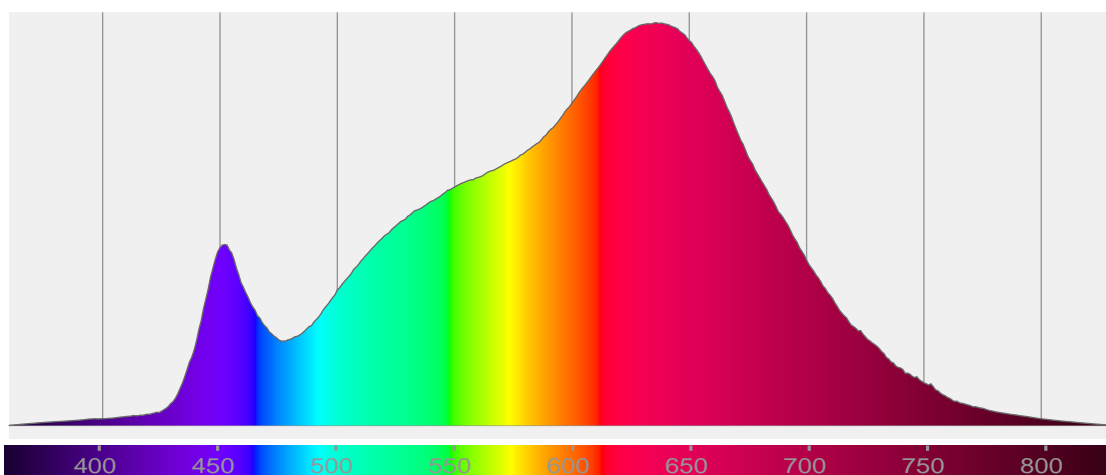


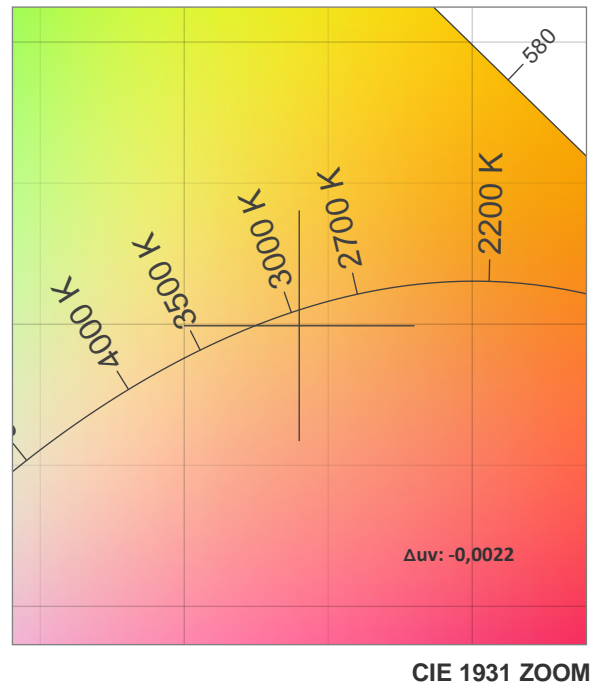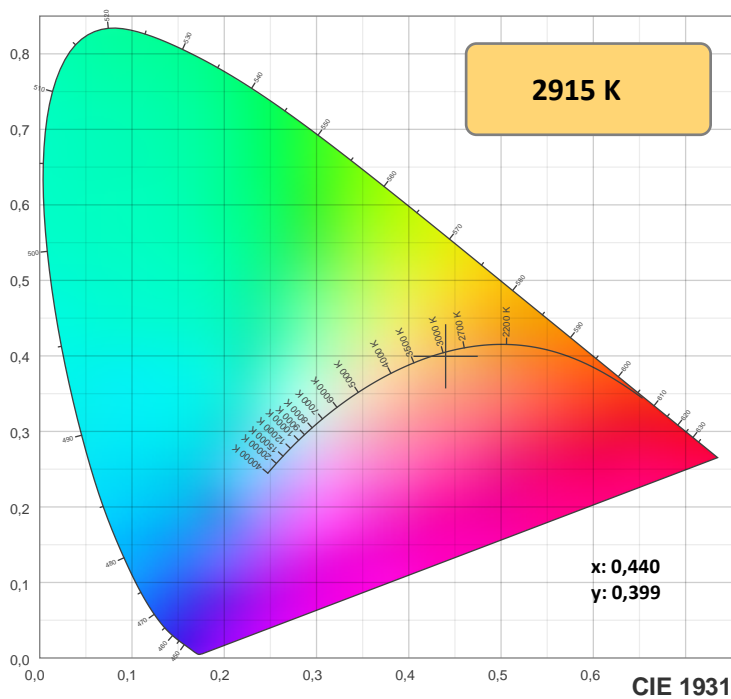

TM-30: 94,6

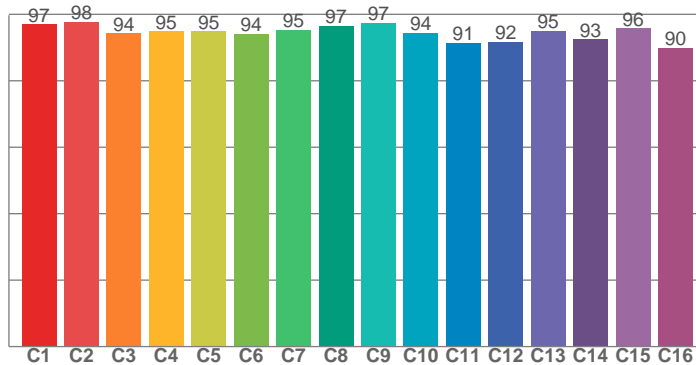

CRI: 97,8 (R1-R8)

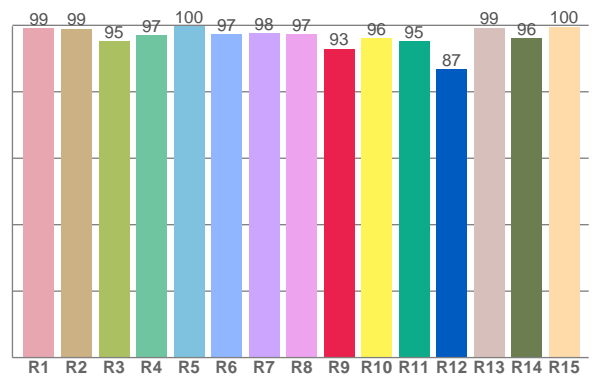

CRIRA R1-R8 / CRIR R1-R15

R1	R2	R3	R4	R5	R6	R7	R8	R9	R10	R11	R12	R13	R14	R15
99,1	99,0	95,2	97,1	99,7	97,3	97,6	97,3	92,9	96,2	95,3	86,8	99,3	96,2	99,6

TM30 valores C. 16 valores extraídos dos 99.

C1	C2	C3	C4	C5	C6	C7	C8	C9	C10	C11	C12	C13	C14	C15	C16
97,0	97,8	94,3	94,9	94,9	94,2	95,4	96,6	97,4	94,4	91,4	91,7	95,0	92,5	95,8	89,8

## Parametros de cor

Temperatura de cor	Índice de reprodução de cor	Reprodução de cor vermelho R9	Color fidelity	Color gamut	Color quality scale	Coordenada de cor cie 1931	Coordenada de cor cie 1931	Coordenada de cor	Coordenada de cor	Color deviation from black body
CCT	IRC	CRI R9	TM30 Rf	TM30 Rg	CQS	x	y	u	v	$\Delta uv$
2915 K	97,8	92,9	94,6	102,9	94,1	0,440	0,399	0,255	0,347	-0,0022







**Rf 94,6**

Fidelity index Rf

**Rg 102,9**

Gamut index Rg

Hue Bin	R <sub>f</sub>	Shifts (%)	
		Chroma	Hue
1	97	-1%	0%
2	98	0%	1%
3	94	0%	3%
4	95	0%	1%
5	95	2%	3%
6	94	4%	1%
7	95	1%	-1%
8	97	1%	-2%
9	97	0%	1%
10	94	0%	3%
11	91	2%	6%
12	92	4%	2%
13	95	3%	-2%
14	93	5%	-3%
15	96	1%	-2%
16	90	2%	-8%

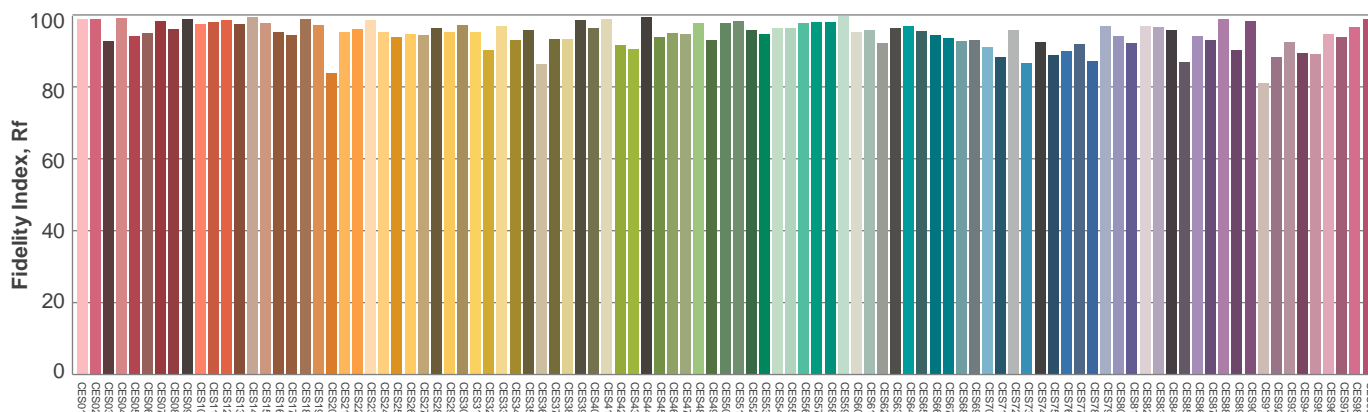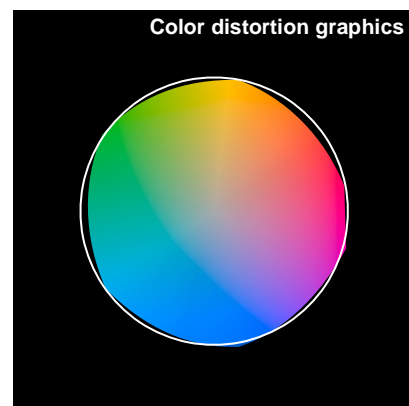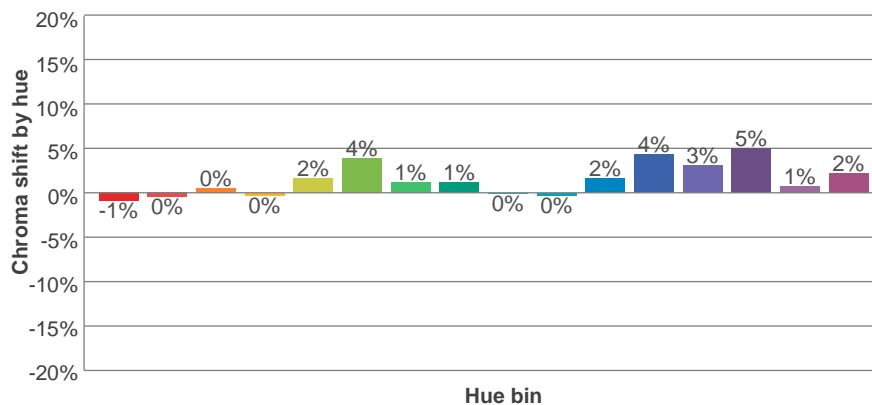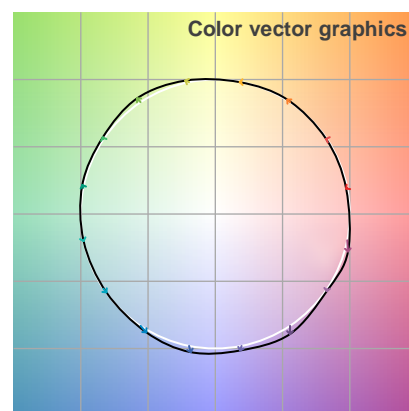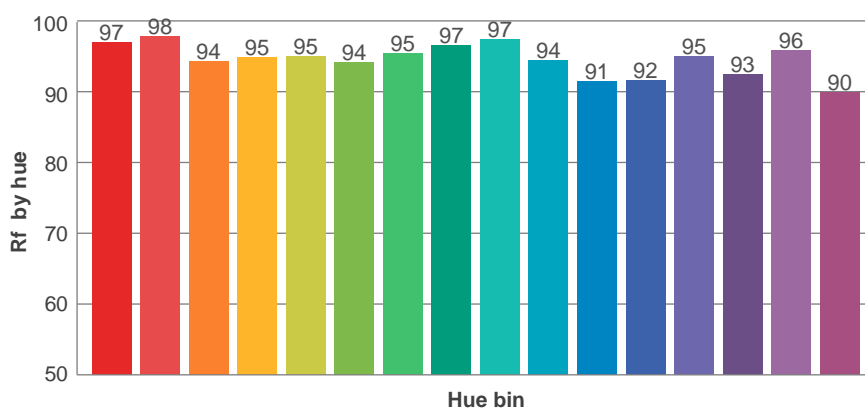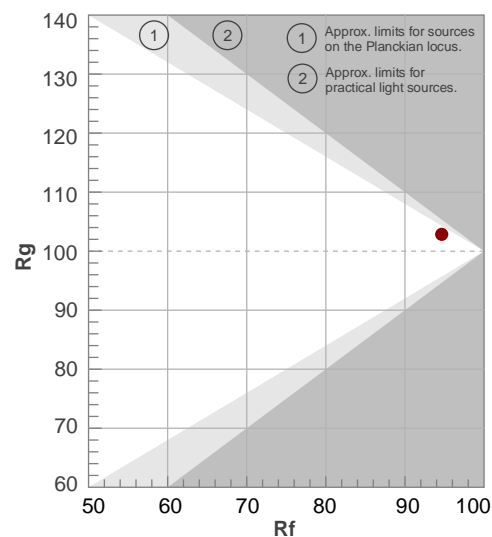

Avaliação todas as amostras de cores

Glare Evaluation According to UGR


p Ceiling		70	70	50	50	30	70	70	50	50	30
p Walls		50	30	50	30	30	50	30	50	30	30
p Floor		20	20	20	20	20	20	20	20	20	20
Room size X    Y		Viewing direction at right angles to lamp axis					Viewing direction parallel to lamp axis				
2H	2H	16,2	17,1	17,1	17,9	19,0	16,1	17,0	17,0	17,8	19,0
	3H	17,6	18,4	18,6	19,3	20,4	17,6	18,3	18,5	19,2	20,3
	4H	18,2	18,9	19,1	19,8	20,9	18,1	18,8	19,1	19,7	20,8
	6H	18,5	19,1	19,5	20,1	21,2	18,5	19,1	19,4	20,1	21,2
	8H	18,6	19,3	19,6	20,2	21,3	18,7	19,3	19,6	20,2	21,3
	12H	18,7	19,4	19,6	20,2	21,3	18,7	19,5	19,7	20,3	21,4
4H	2H	16,7	17,4	17,7	18,3	19,4	16,7	17,4	17,6	18,3	19,4
	3H	18,3	19,1	19,3	19,9	21,0	18,3	19,0	19,2	19,8	21,0
	4H	18,9	19,9	19,9	20,5	21,6	18,9	19,9	19,9	20,4	21,6
	6H	19,4	19,9	20,4	20,8	21,9	19,4	20,0	20,4	20,8	22,0
	8H	19,5	19,9	20,5	20,9	22,0	19,6	20,0	20,6	21,0	22,1
	12H	19,6	19,9	20,5	20,9	22,0	19,7	20,0	20,7	21,0	22,1
8H	4H	19,1	19,5	20,1	20,5	21,6	19,1	19,5	20,1	20,5	21,6
	6H	19,7	20,0	20,7	21,0	22,2	19,7	20,0	20,7	21,1	22,2
	8H	19,9	20,1	20,9	21,2	22,4	20,0	20,2	21,0	21,3	22,5
	12H	20,0	20,2	21,0	21,3	22,4	20,1	20,4	21,2	21,4	22,6
12H	4H	19,1	19,4	20,1	20,4	21,6	19,1	19,4	20,0	20,4	21,5
	6H	19,7	20,0	20,7	21,0	22,2	19,8	20,0	20,8	21,1	22,3
	8H	19,9	20,2	21,0	21,2	22,3	20,0	20,2	21,1	21,3	22,4
Variation of the observer position for the luminaire distance S											
S = 1.0H		0,1 / -0,1					0,1 / -0,1				
S = 1.5H		0,2 / -0,3					0,1 / -0,2				
S = 2.0H		0,4 / -0,5					0,4 / -0,5				
Standard table		n/a					n/a				
Correction summand		n/a					n/a				
Corrected glare indices referring to 1566 lm total luminous flux											


### Coeficiente de utilização

Ceiling reflectance	80				70				50			30			10			0
Wall reflectance	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
Floor reflectance	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	0
RCR	(RCR: Room Cavity Ratio) Room Values are expressed as percentage of Lumens delivered to the task surface																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56	50
1	98	93	89	86	90	86	83	80	73	70	68	61	59	57	49	48	47	42
2	89	81	75	70	82	75	70	65	64	60	56	53	50	48	43	41	39	35
3	81	71	64	58	74	66	60	54	56	51	47	47	43	40	38	36	33	29
4	74	63	55	49	68	58	51	46	50	44	40	42	38	34	34	31	29	25
5	68	56	48	42	62	52	45	39	44	39	34	37	33	30	31	27	25	22
6	62	50	42	36	57	47	39	34	40	34	30	34	29	26	28	24	22	19
7	58	45	37	32	53	42	35	30	36	30	26	31	26	23	25	22	19	17
8	53	41	33	28	49	38	31	26	33	27	23	28	23	20	23	20	17	15
9	50	37	30	25	46	35	28	23	30	25	21	26	21	18	21	18	16	13
10	46	34	27	22	43	32	25	21	28	22	19	24	19	16	20	16	14	12

### Quantidade de luminárias

### Luminaire budgetary diagram

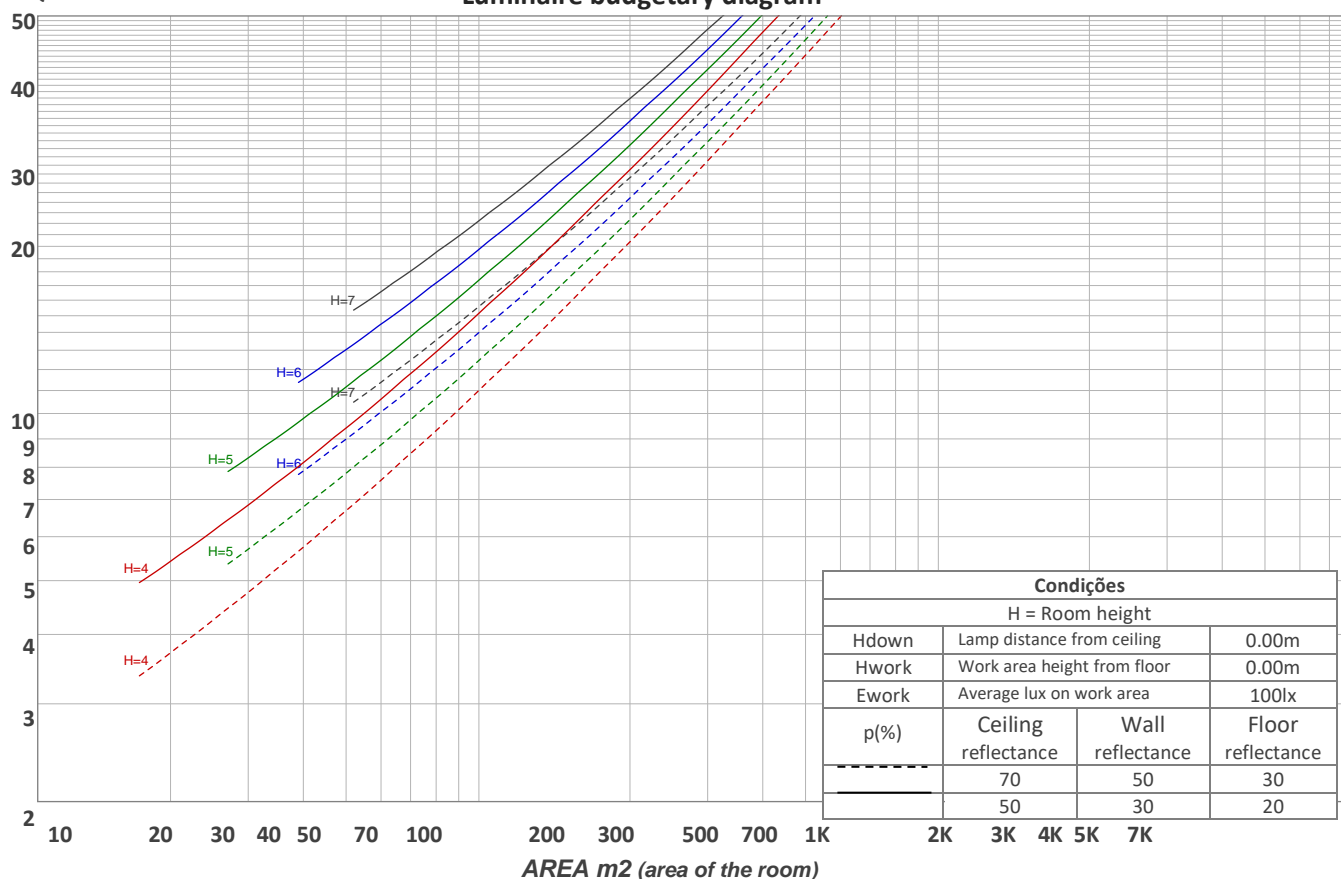

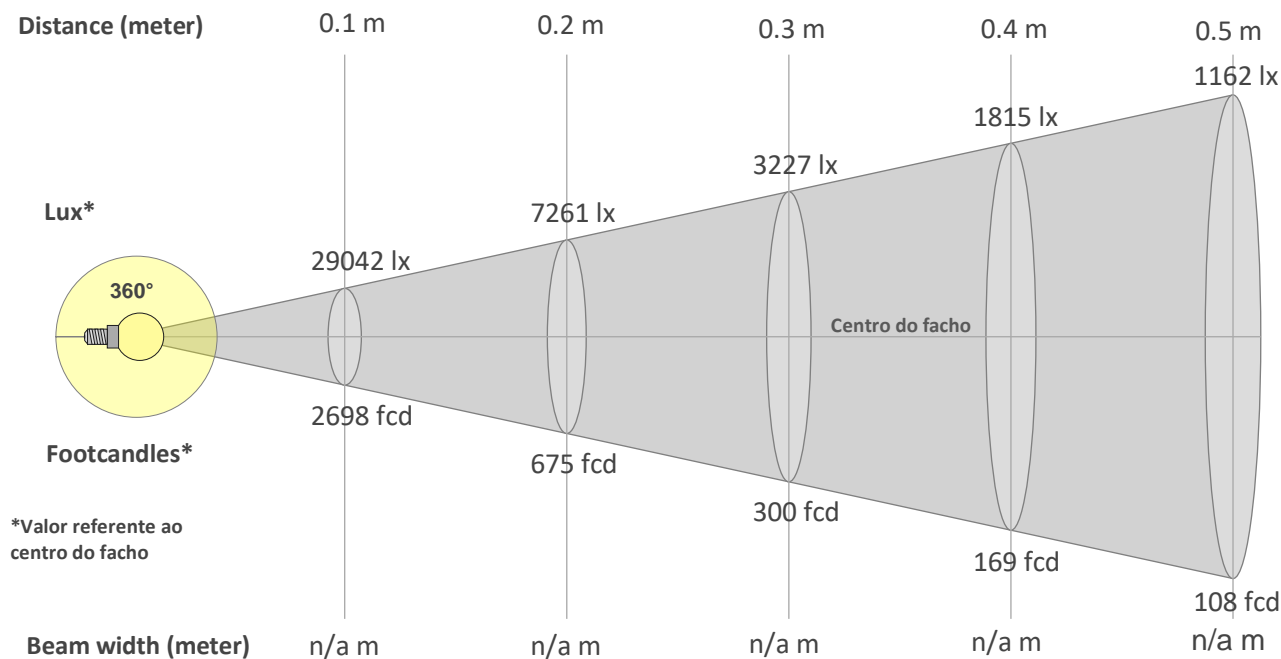

### Beam intensities from 1-20m

1m	2m	3m	4m	5m	6m	7m	8m	9m	10m	11m	12m	13m	14m	15m	16m	17m	18m	19m	20m
3,3ft	6,6ft	9,8ft	13,1ft	16,4ft	19,7ft	23ft	26,2ft	29,5ft	32,8ft	36,1ft	39,4ft	42,7ft	45,9ft	49,2ft	52,5ft	55,8ft	59,1ft	62,3ft	65,6ft
290lx	73lx	32lx	18lx	12lx	8lx	6lx	5lx	4lx	3lx	2lx	2lx	2lx	1lx	1lx	1lx	1lx	1lx	1lx	1lx
27fcd	6,7fcd	3fcd	1,7fcd	1,1fcd	0,7fcd	0,6fcd	0,4fcd	0,3fcd	0,3fcd	0,2fcd	0,2fcd	0,2fcd	0,1fcd	0,1fcd	0,1fcd	0,1fcd	0,1fcd	0,1fcd	0,1fcd

### Intensities in 0° c-plane

0°	9°	18°	27°	36°	45°	54°	63°	72°	81°	90°	99°	108°	117°	126°	135°	144°	153°	162°	171°
290	285	270	246	217	182	145	104	64	24	3	24	64	105	145	182	217	246	270	285
100%	98%	93%	85%	75%	63%	50%	36%	22%	8%	1%	8%	22%	36%	50%	63%	75%	85%	93%	98%

### Intensities in 90° c-plane

0°	9°	18°	27°	36°	45°	54°	63°	72°	81°	90°	99°	108°	117°	126°	135°	144°	153°	162°	171°
290	284	268	244	213	178	142	103	63	27	7	28	64	103	142	179	213	243	267	283
100%	98%	92%	84%	73%	61%	49%	35%	22%	9%	3%	10%	22%	35%	49%	62%	73%	84%	92%	97%

### Intensities in 180° c-plane


0°	9°	18°	27°	36°	45°	54°	63°	72°	81°	90°	99°	108°	117°	126°	135°	144°	153°	162°	171°
290	285	270	246	217	182	145	104	64	24	3	24	64	105	145	182	217	246	270	285
100%	98%	93%	85%	75%	63%	50%	36%	22%	8%	1%	8%	22%	36%	50%	63%	75%	85%	93%	98%

### Intensities in 270° c-plane

0°	9°	18°	27°	36°	45°	54°	63°	72°	81°	90°	99°	108°	117°	126°	135°	144°	153°	162°	171°
290	284	268	244	213	178	142	103	63	27	7	28	64	103	142	179	213	243	267	283
100%	98%	92%	84%	73%	61%	49%	35%	22%	9%	3%	10%	22%	35%	49%	62%	73%	84%	92%	97%

Beam angle 50%	Field angle 10%	Cutoff angle 2,5%	Intensity ratio in 120° cone	Intensity ratio in 90° cone
360°	360°	360°	39,6%	26,8%

**iso-candela diagram**

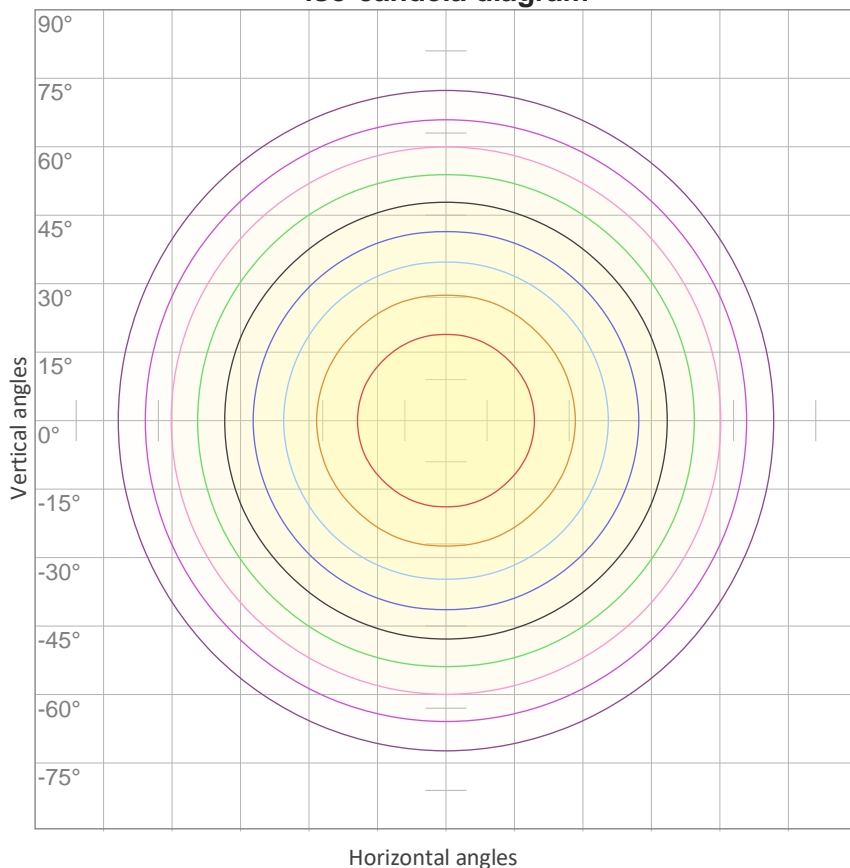


10%	29 cd
20%	58 cd
30%	87 cd
40%	116 cd
50%	145 cd
60%	174 cd
70%	203 cd
80%	232 cd
90%	261 cd

Conditions:

Number of c-planes: 16

Candela at center: 290 cd

**iso-lux diagram**

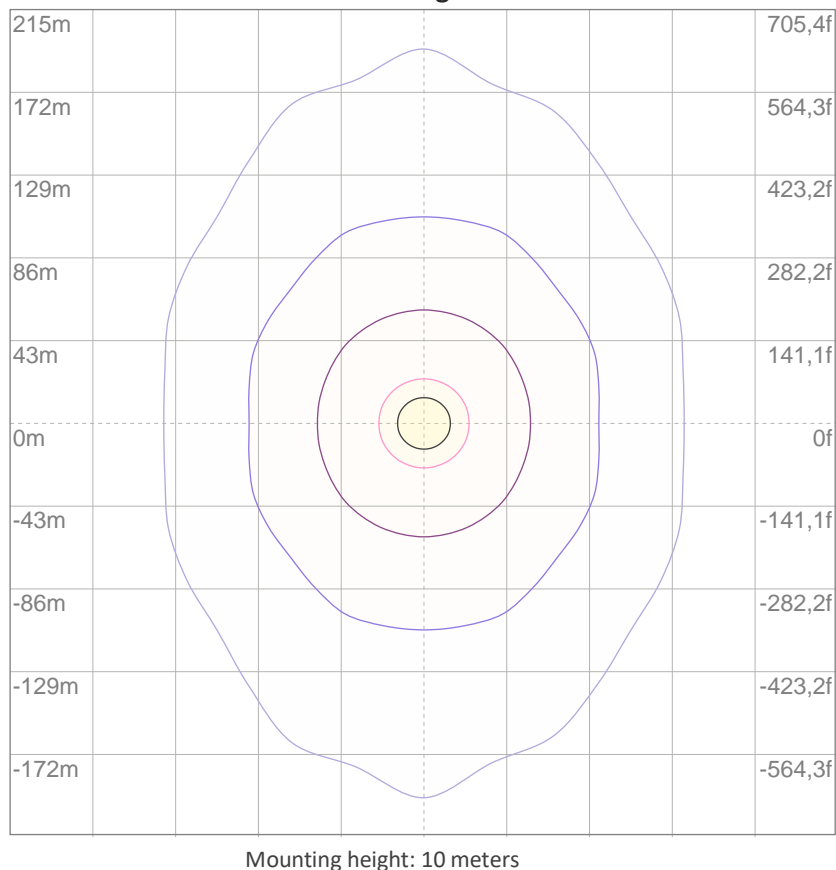

3%	87,1m lx
5%	0,145 lx
10%	0,290 lx
30%	0,871 lx
50%	1,45 lx

Conditions:

Number of c-planes: 16

Lux at center: 2,90 lx

*Lux distribution on a surface when lamp is mounted at 10 meters from the surface.*

Potência


**Vttagem: 12,0 V**

**Corrente: 2,48 A**

**Frequência: 0 Hz**

**FP: 0,99**

THD



**THD corrente: n/a**

**THD tensão: n/a**