


W96 SLED9006 BRANCA FITA 15WM 5700K 95 - 1m

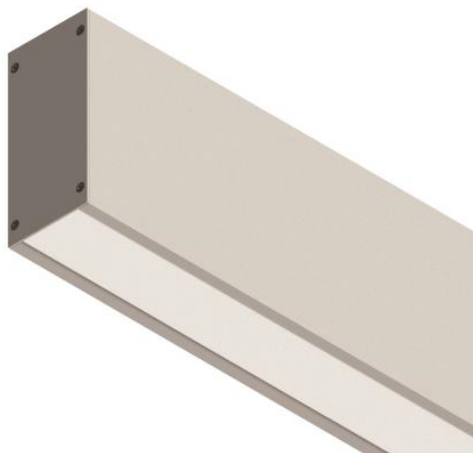

Luminária linear de sobrepor na parede com iluminação difusa. Corpo em alumínio extrudado com acabamento na cor branca. Difusor em acrílico extrudado leitoso. Indicado para residência, recepção, escritório etc.

Fluxo luminoso – 812 lm/m

Potência – 15,4 W/m

Intensidade pico – 295cd

CCT – 5676K



IRC – 96,2

Coordenada CIE 1931 – x- 0,329 y- 0,341

A x L - 96x46

Peso - 1,43kg/m


IP - 20 - Uso Interno

IK - 00 – Não aplicável

Alimentação - 12vdc

Data do ensaio

06/04/2022 15:53:47

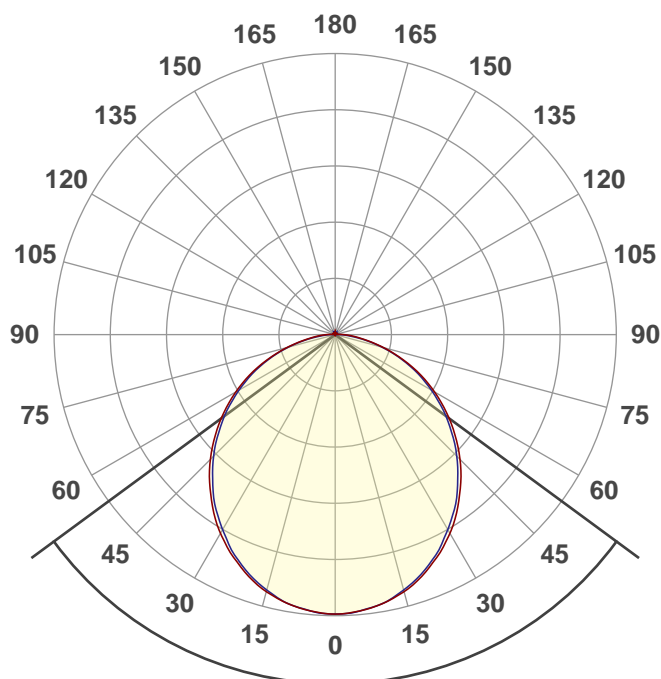

Facho de abertura

107,3°


Rf 94,1



Fidelity index Rf

Rg 101,8


Gamut index Rg

Hue Bin	R _f	Shifts (%)	
		Chroma	Hue
1	94	2%	0%
2	97	2%	-1%
3	94	1%	-3%
4	94	-2%	-3%
5	92	-5%	-2%
6	98	-1%	1%
7	96	-1%	3%
8	94	0%	4%
9	94	1%	5%
10	94	2%	4%
11	91	3%	5%
12	98	1%	0%
13	96	2%	1%
14	96	1%	1%
15	88	9%	-3%
16	96	2%	1%

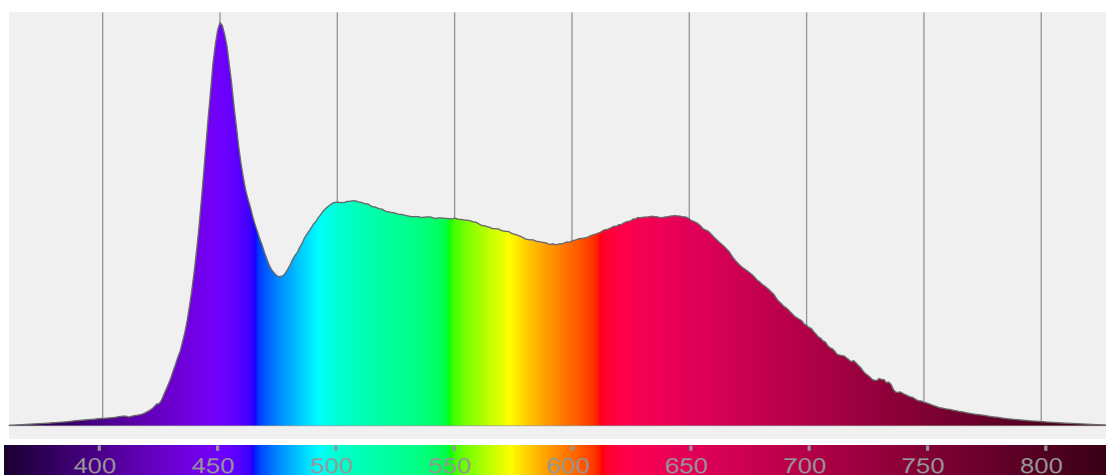


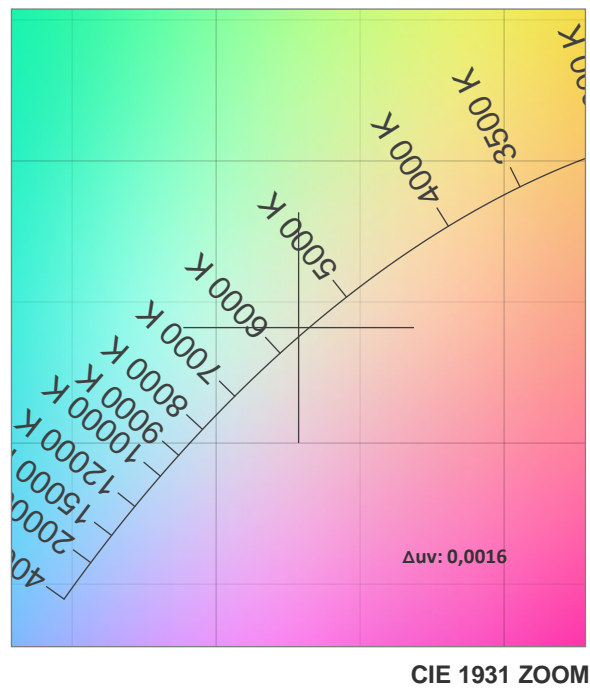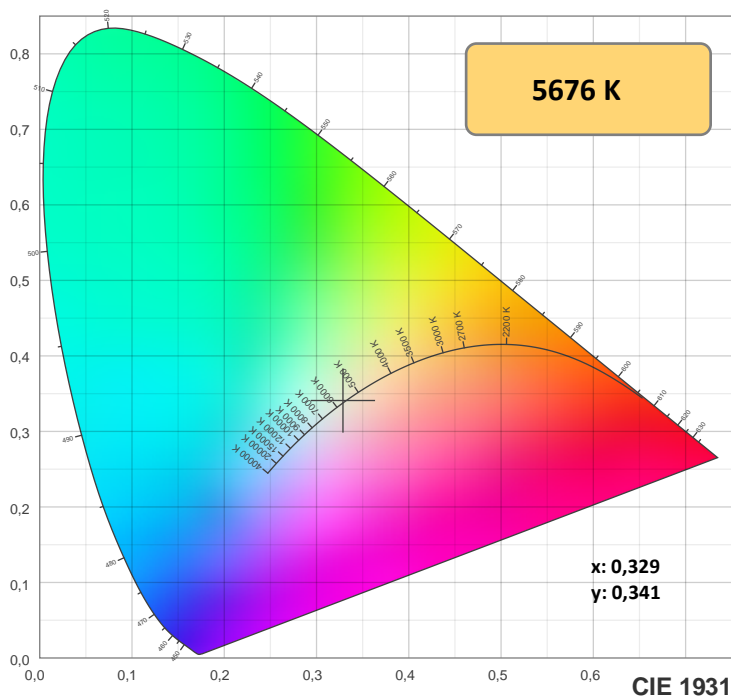

TM-30: 94,1

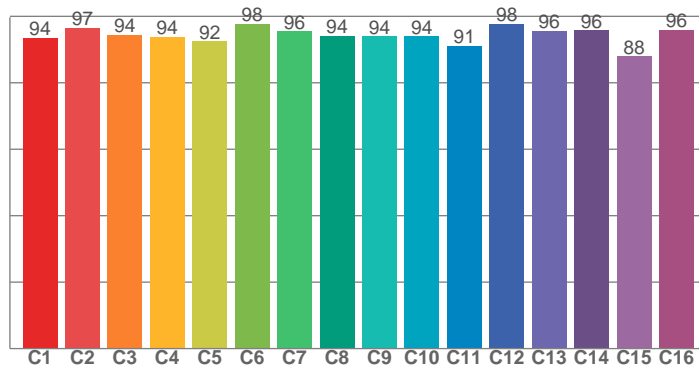

CRI: 96,2 (R1-R8)

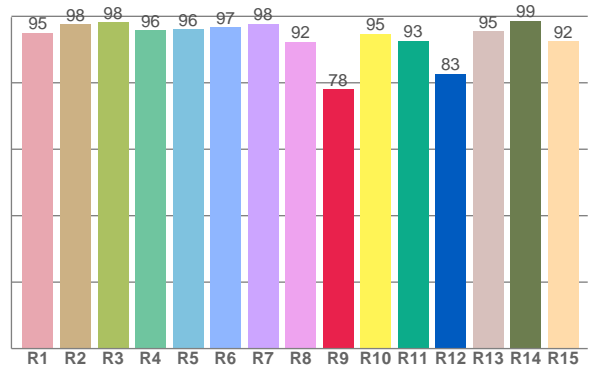

CRIRA R1-R8 / CRIR R1-R15

R1	R2	R3	R4	R5	R6	R7	R8	R9	R10	R11	R12	R13	R14	R15
95,1	97,7	98,3	95,8	96,1	96,7	97,7	92,4	78,1	94,7	92,6	82,7	95,5	98,7	92,5

TM30 valores C. 16 valores extraídos dos 99.

C1	C2	C3	C4	C5	C6	C7	C8	C9	C10	C11	C12	C13	C14	C15	C16
93,5	96,6	94,4	93,8	92,5	97,8	95,5	94,1	94,0	93,9	91,1	97,7	95,7	95,7	87,9	96,0

Parametros de cor

Temperatura de cor	Índice de reprodução de cor	Reprodução de cor vermelho R9	Color fidelity	Color gamut	Color quality scale	Coordenada de cor cie 1931	Coordenada de cor cie 1931	Coordenada de cor	Coordenada de cor	Color deviation from black body
CCT	IRC	CRI R9	TM30 Rf	TM30 Rg	CQS	x	y	u	v	Δuv
5676 K	96,2	78,1	94,1	101,8	97,2	0,329	0,341	0,204	0,318	0,0016







Rf 94,1

Fidelity index R_f

Rg 101,8

Gamut index Rg

		Shifts (%)	
Hue Bin	R_t	Chroma	Hue
1	94	2%	0%
2	97	2%	-1%
3	94	1%	-3%
4	94	-2%	-3%
5	92	-5%	-2%
6	98	-1%	1%
7	96	-1%	3%
8	94	0%	4%
9	94	1%	5%
10	94	2%	4%
11	91	3%	5%
12	98	1%	0%
13	96	2%	1%
14	96	1%	1%
15	88	9%	-3%
16	96	2%	1%

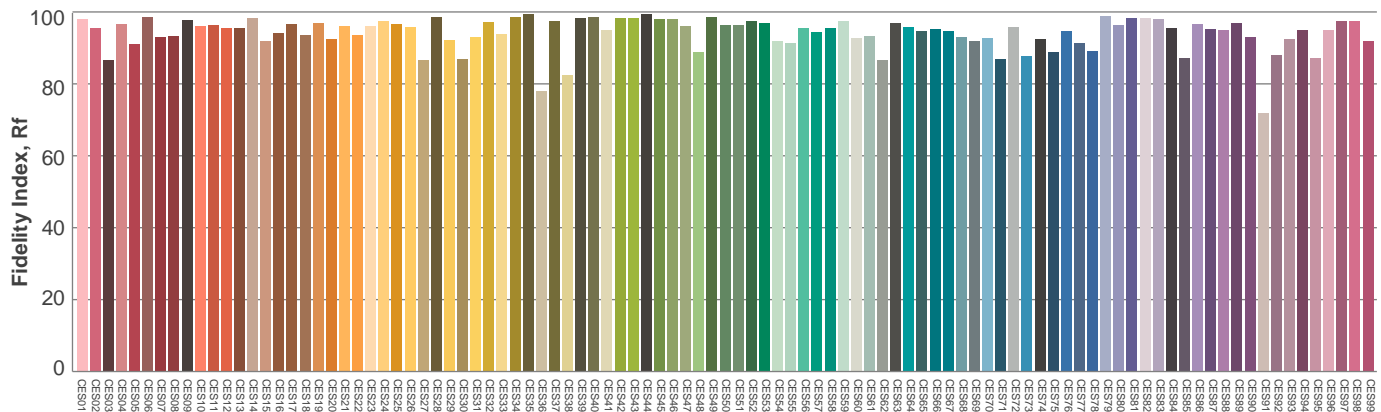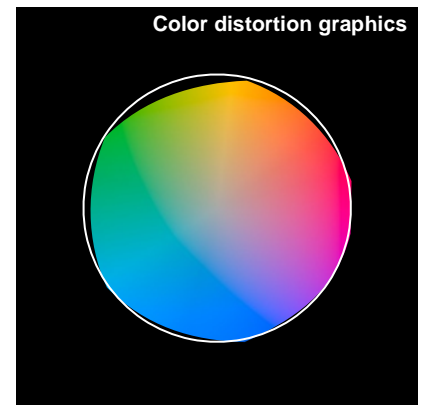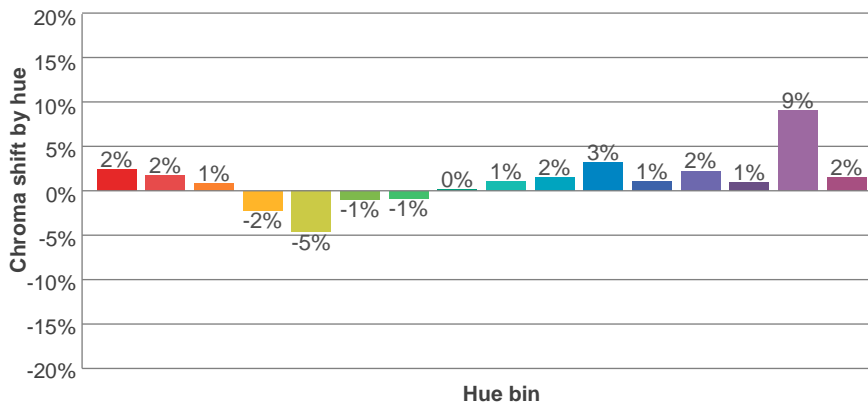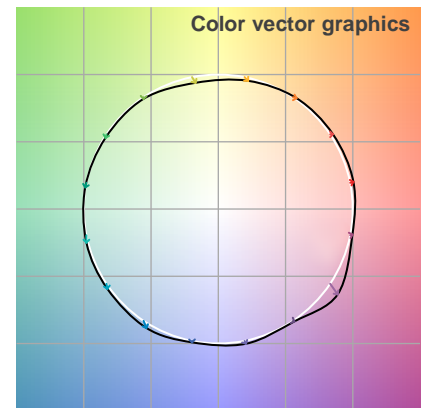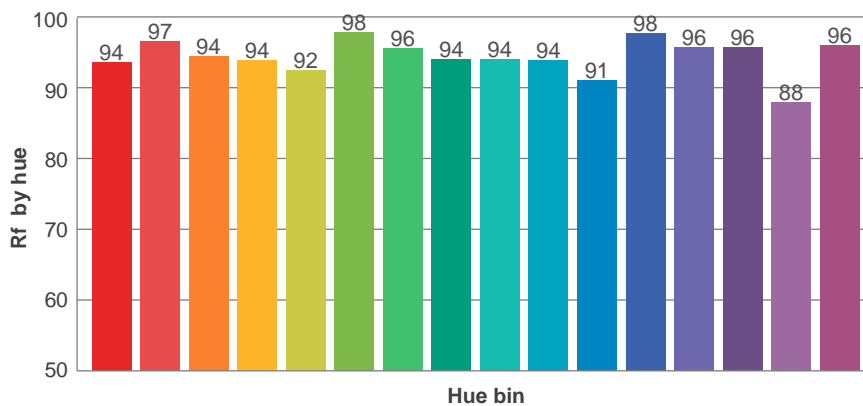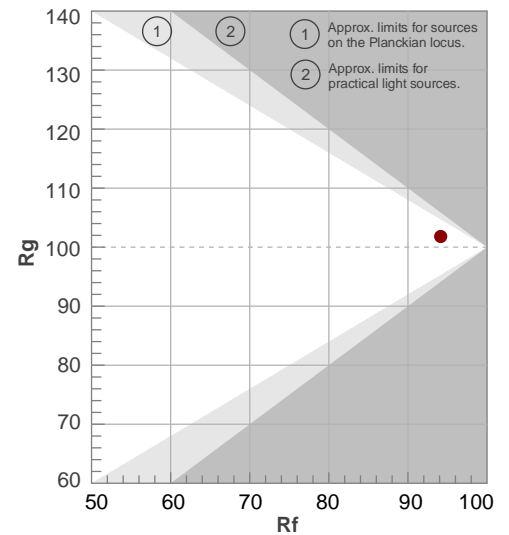

Avaliação todas as amostras de cores

Glare Evaluation According to UGR


p Ceiling		70	70	50	50	30	70	70	50	50	30
p Walls		50	30	50	30	30	50	30	50	30	30
p Floor		20	20	20	20	20	20	20	20	20	20
Room size X Y		Viewing direction at right angles to lamp axis					Viewing direction parallel to lamp axis				
2H	2H	19,7	20,9	19,9	21,2	21,4	19,5	20,7	19,8	21,0	21,3
	3H	21,1	22,4	21,5	22,7	22,9	21,0	22,2	21,4	22,5	22,7
	4H	21,7	22,9	22,2	23,2	23,5	21,6	22,8	22,0	23,1	23,3
	6H	22,3	23,3	22,6	23,6	24,0	22,1	23,1	22,4	23,4	23,8
	8H	22,5	23,5	22,8	23,8	24,2	22,2	23,2	22,6	23,6	24,0
	12H	22,6	23,6	23,0	24,0	24,4	22,3	23,3	22,7	23,7	24,1
4H	2H	20,2	21,4	20,7	21,7	22,0	20,1	21,3	20,5	21,6	21,9
	3H	22,0	23,0	22,4	23,4	23,8	21,9	22,9	22,3	23,2	23,7
	4H	22,7	23,6	23,2	24,0	24,6	22,5	23,5	23,0	23,9	24,5
	6H	23,3	24,2	23,8	24,5	24,9	23,1	24,0	23,6	24,4	24,8
	8H	23,5	24,3	24,1	24,7	25,1	23,3	24,1	23,8	24,5	24,9
	12H	23,8	24,4	24,3	24,9	25,4	23,5	24,1	24,0	24,6	25,1
8H	4H	23,0	23,8	23,5	24,1	24,6	22,8	23,6	23,4	24,0	24,4
	6H	23,7	24,3	24,3	24,8	25,4	23,6	24,2	24,1	24,7	25,2
	8H	24,1	24,6	24,6	25,2	25,8	23,9	24,4	24,4	24,9	25,6
	12H	24,5	24,9	25,1	25,4	26,1	24,1	24,5	24,7	25,1	25,7
12H	4H	23,0	23,6	23,5	24,1	24,6	22,9	23,5	23,4	24,0	24,5
	6H	23,8	24,3	24,3	24,9	25,5	23,7	24,2	24,2	24,7	25,4
	8H	24,2	24,6	24,8	25,2	25,8	24,0	24,4	24,6	24,9	25,6
Variation of the observer position for the luminaire distance S											
S = 1.0H		0,1 / -0,1					0,1 / -0,1				
S = 1.5H		0,1 / -0,2					0,1 / -0,2				
S = 2.0H		0,4 / -0,4					0,4 / -0,5				
Standard table		n/a					n/a				
Correction summand		n/a					n/a				
Corrected glare indices referring to 812 lm total luminous flux											


Coeficiente de utilização

Ceiling reflectance	80				70				50			30			10			0
Wall reflectance	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
Floor reflectance	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	0
RCR	(RCR: Room Cavity Ratio) Room Values are expressed as percentage of Lumens delivered to the task surface																	
0	119	119	119	119	116	116	116	116	110	110	110	105	105	105	101	101	101	99
1	108	103	99	95	105	101	97	94	97	93	90	92	90	87	89	87	85	82
2	99	90	83	78	96	88	82	77	84	79	75	81	77	73	78	74	71	69
3	90	79	71	65	87	78	70	64	74	68	63	71	66	61	69	64	60	58
4	82	70	61	55	80	69	61	54	66	59	53	64	58	53	61	56	52	49
5	76	63	54	47	73	62	53	47	59	52	46	57	51	46	55	50	45	43
6	70	57	48	41	68	56	47	41	54	46	41	52	45	40	50	44	40	38
7	65	51	43	36	63	50	42	36	49	41	36	47	41	36	46	40	35	33
8	60	47	38	33	59	46	38	32	45	37	32	43	37	32	42	36	32	30
9	56	43	35	29	55	42	35	29	41	34	29	40	33	29	39	33	29	27
10	53	40	32	27	52	39	32	27	38	31	26	37	31	26	36	30	26	24

Quantidade de luminárias

Luminaire budgetary diagram

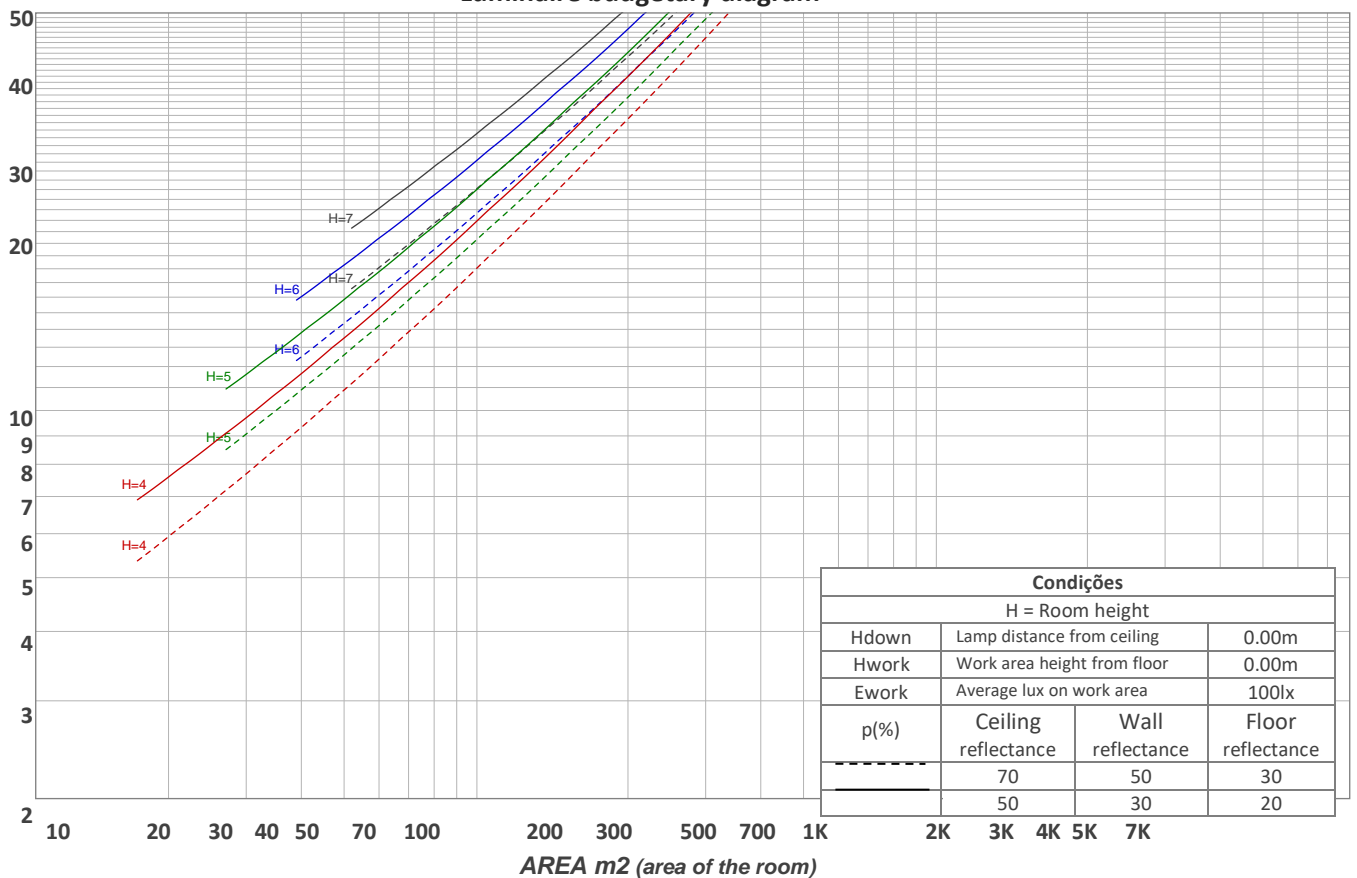

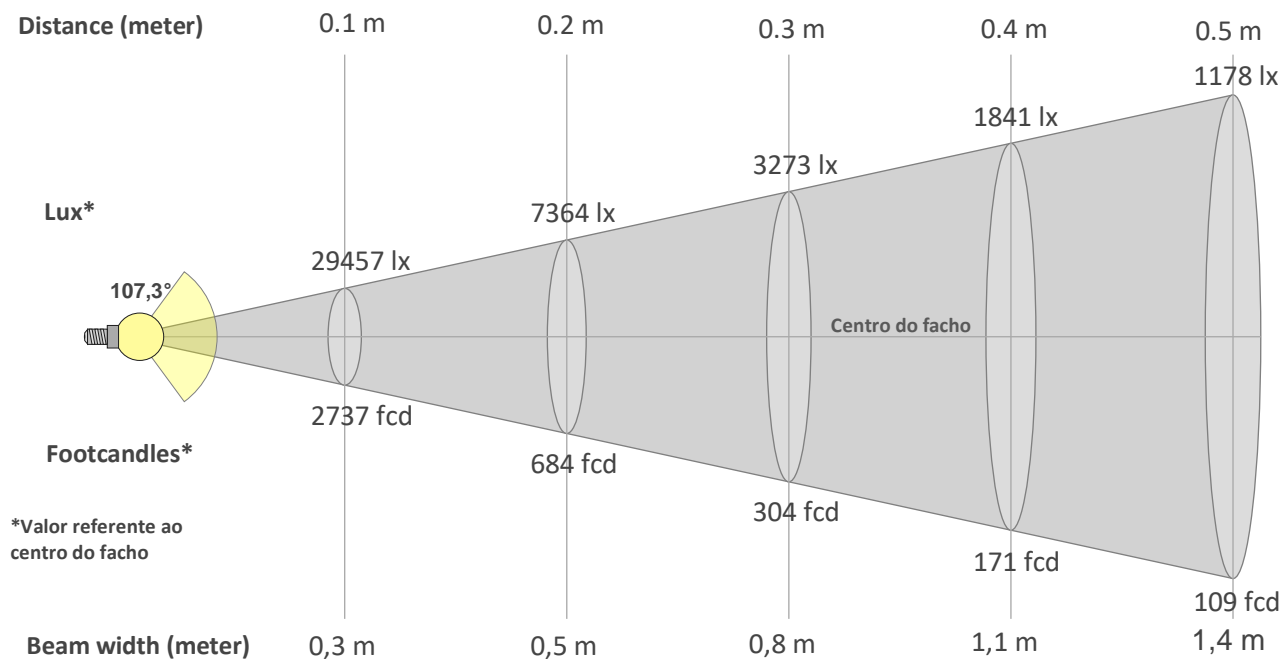

Beam intensities from 1-20m

1m	2m	3m	4m	5m	6m	7m	8m	9m	10m	11m	12m	13m	14m	15m	16m	17m	18m	19m	20m
3,3ft	6,6ft	9,8ft	13,1ft	16,4ft	19,7ft	23ft	26,2ft	29,5ft	32,8ft	36,1ft	39,4ft	42,7ft	45,9ft	49,2ft	52,5ft	55,8ft	59,1ft	62,3ft	65,6ft
295lx	74lx	33lx	18lx	12lx	8lx	6lx	5lx	4lx	3lx	2lx	2lx	2lx	2lx	1lx	1lx	1lx	1lx	1lx	1lx
27,4fcd	6,8fcd	3fcd	1,7fcd	1,1fcd	0,8fcd	0,6fcd	0,4fcd	0,3fcd	0,3fcd	0,2fcd	0,2fcd	0,2fcd	0,1fcd	0,1fcd	0,1fcd	0,1fcd	0,1fcd	0,1fcd	0,1fcd

Intensities in 0° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°
295	293	288	281	270	257	242	225	206	186	165	143	121	98	75	53	33	19	9	3
100%	99%	98%	95%	92%	87%	82%	76%	70%	63%	56%	49%	41%	33%	25%	18%	11%	7%	3%	1%

Intensities in 90° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°
295	293	288	279	268	254	237	221	201	181	160	139	117	95	73	51	31	15	5	2
100%	99%	98%	95%	91%	86%	81%	75%	68%	62%	54%	47%	40%	32%	25%	17%	10%	5%	2%	1%

Intensities in 180° c-plane


0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°
295	293	288	281	270	257	242	225	206	186	165	143	121	98	75	53	33	19	9	3
100%	99%	98%	95%	92%	87%	82%	76%	70%	63%	56%	49%	41%	33%	25%	18%	11%	7%	3%	1%

Intensities in 270° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°
295	293	288	279	268	254	237	221	201	181	160	139	117	95	73	51	31	15	5	2
100%	99%	98%	95%	91%	86%	81%	75%	68%	62%	54%	47%	40%	32%	25%	17%	10%	5%	2%	1%

Beam angle 50%	Field angle 10%	Cutoff angle 2,5%	Intensity ratio in 120° cone	Intensity ratio in 90° cone
107,3°	161,3°	178,7°	77,8%	53,6%

iso-candela diagram

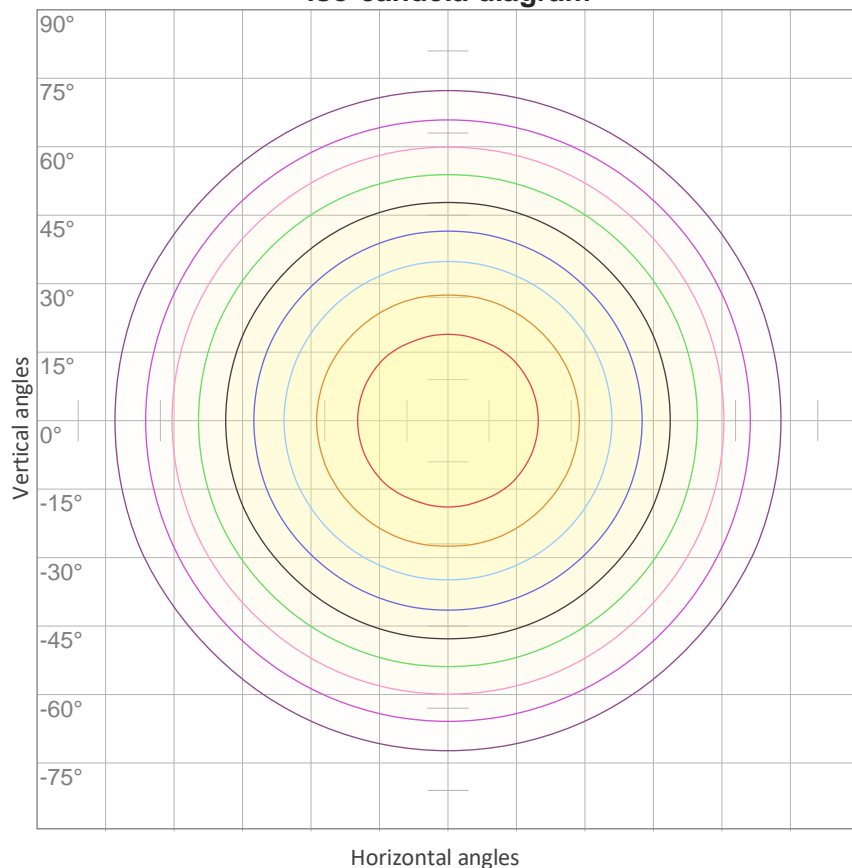


10%	29 cd
20%	59 cd
30%	88 cd
40%	118 cd
50%	147 cd
60%	177 cd
70%	206 cd
80%	236 cd
90%	265 cd

Conditions:

Number of c-planes: 16

Candela at center: 295 cd

iso-lux diagram

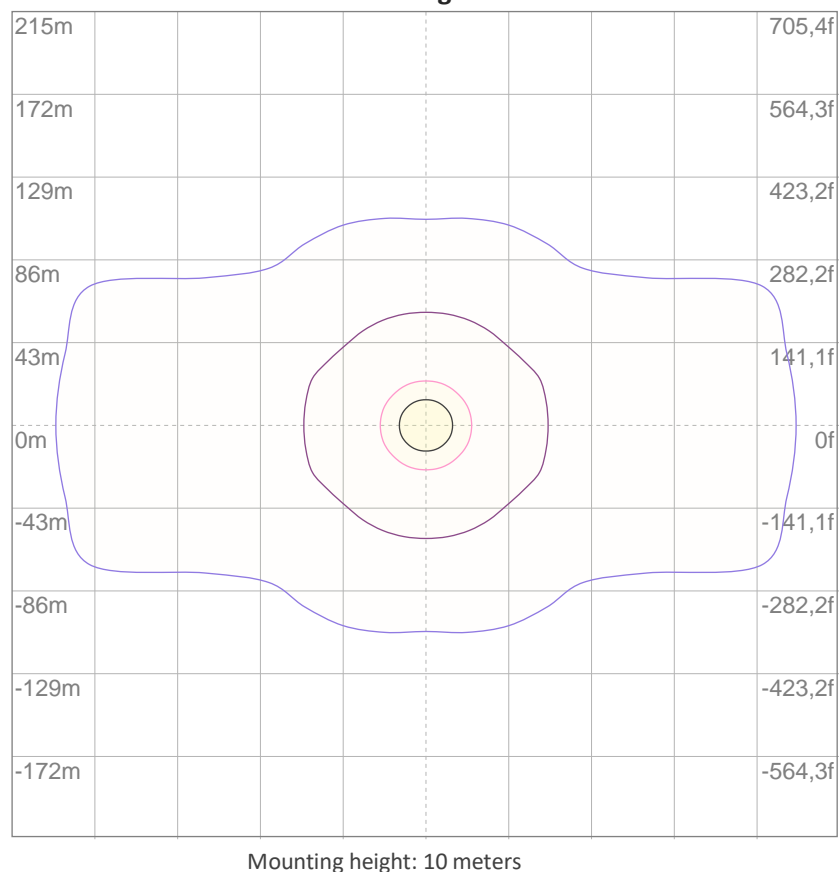

3%	88,4m lx
5%	0,147 lx
10%	0,295 lx
30%	0,884 lx
50%	1,47 lx

Conditions:

Number of c-planes: 16

Lux at center: 2,95 lx

Lux distribution on a surface when lamp is mounted at 10 meters from the surface.

Potência

Vttagem: 12,0 V

Corrente: 1,28 A

Frequência: 0 Hz

FP: 0,99

THD



THD corrente: n/a

THD tensão: n/a